

TOWN OF NEWBURGH PLANNING BOARD TECHNICAL REVIEW COMMENTS

PROJECT NAME: MONARCH WOODS SENIOR HOUSING

PROJECT NO.: 2019-28

PROJECT LOCATION: SECTION 103, BLOCK 7, LOT 18

SECTION 47, BLOCK 1, LOT 46

REVIEW DATE: 27 MAY 2022 MEETING DATE: 2 JUNE 2022

PROJECT REPRESENTATIVE: ENGINEERING & SURVEYING PROPERTIES/ROSS WINGLOVITZ, P.E.

- 1. The Zoning Board of Appeals determined that the Planning Board has the authority to set building height in accordance with Section 185-48B. The applicant was requested to provide renderings of the project for visual assessment from Monarch Drive and NYS Route 52.
- 2. Status of review by the NYS Department of Transportation for the emergency vehicle access drive should be received. Department approval for water main extension with hydrants is required.
- 3. Highway Superintendents comments for Monarch Drive is required.
- 4. City of Newburgh Flow Acceptance letter is required.
- 5. Comments from 21 April 2022 meeting are outstanding. Project requires a Public Hearing after the Planning Board issues a SEQRA Determination.


Respectfully submitted,


MHE Engineering, D.P.C.


Patril of Offenes


Patrick J. Hines


Principal PJH/kbw

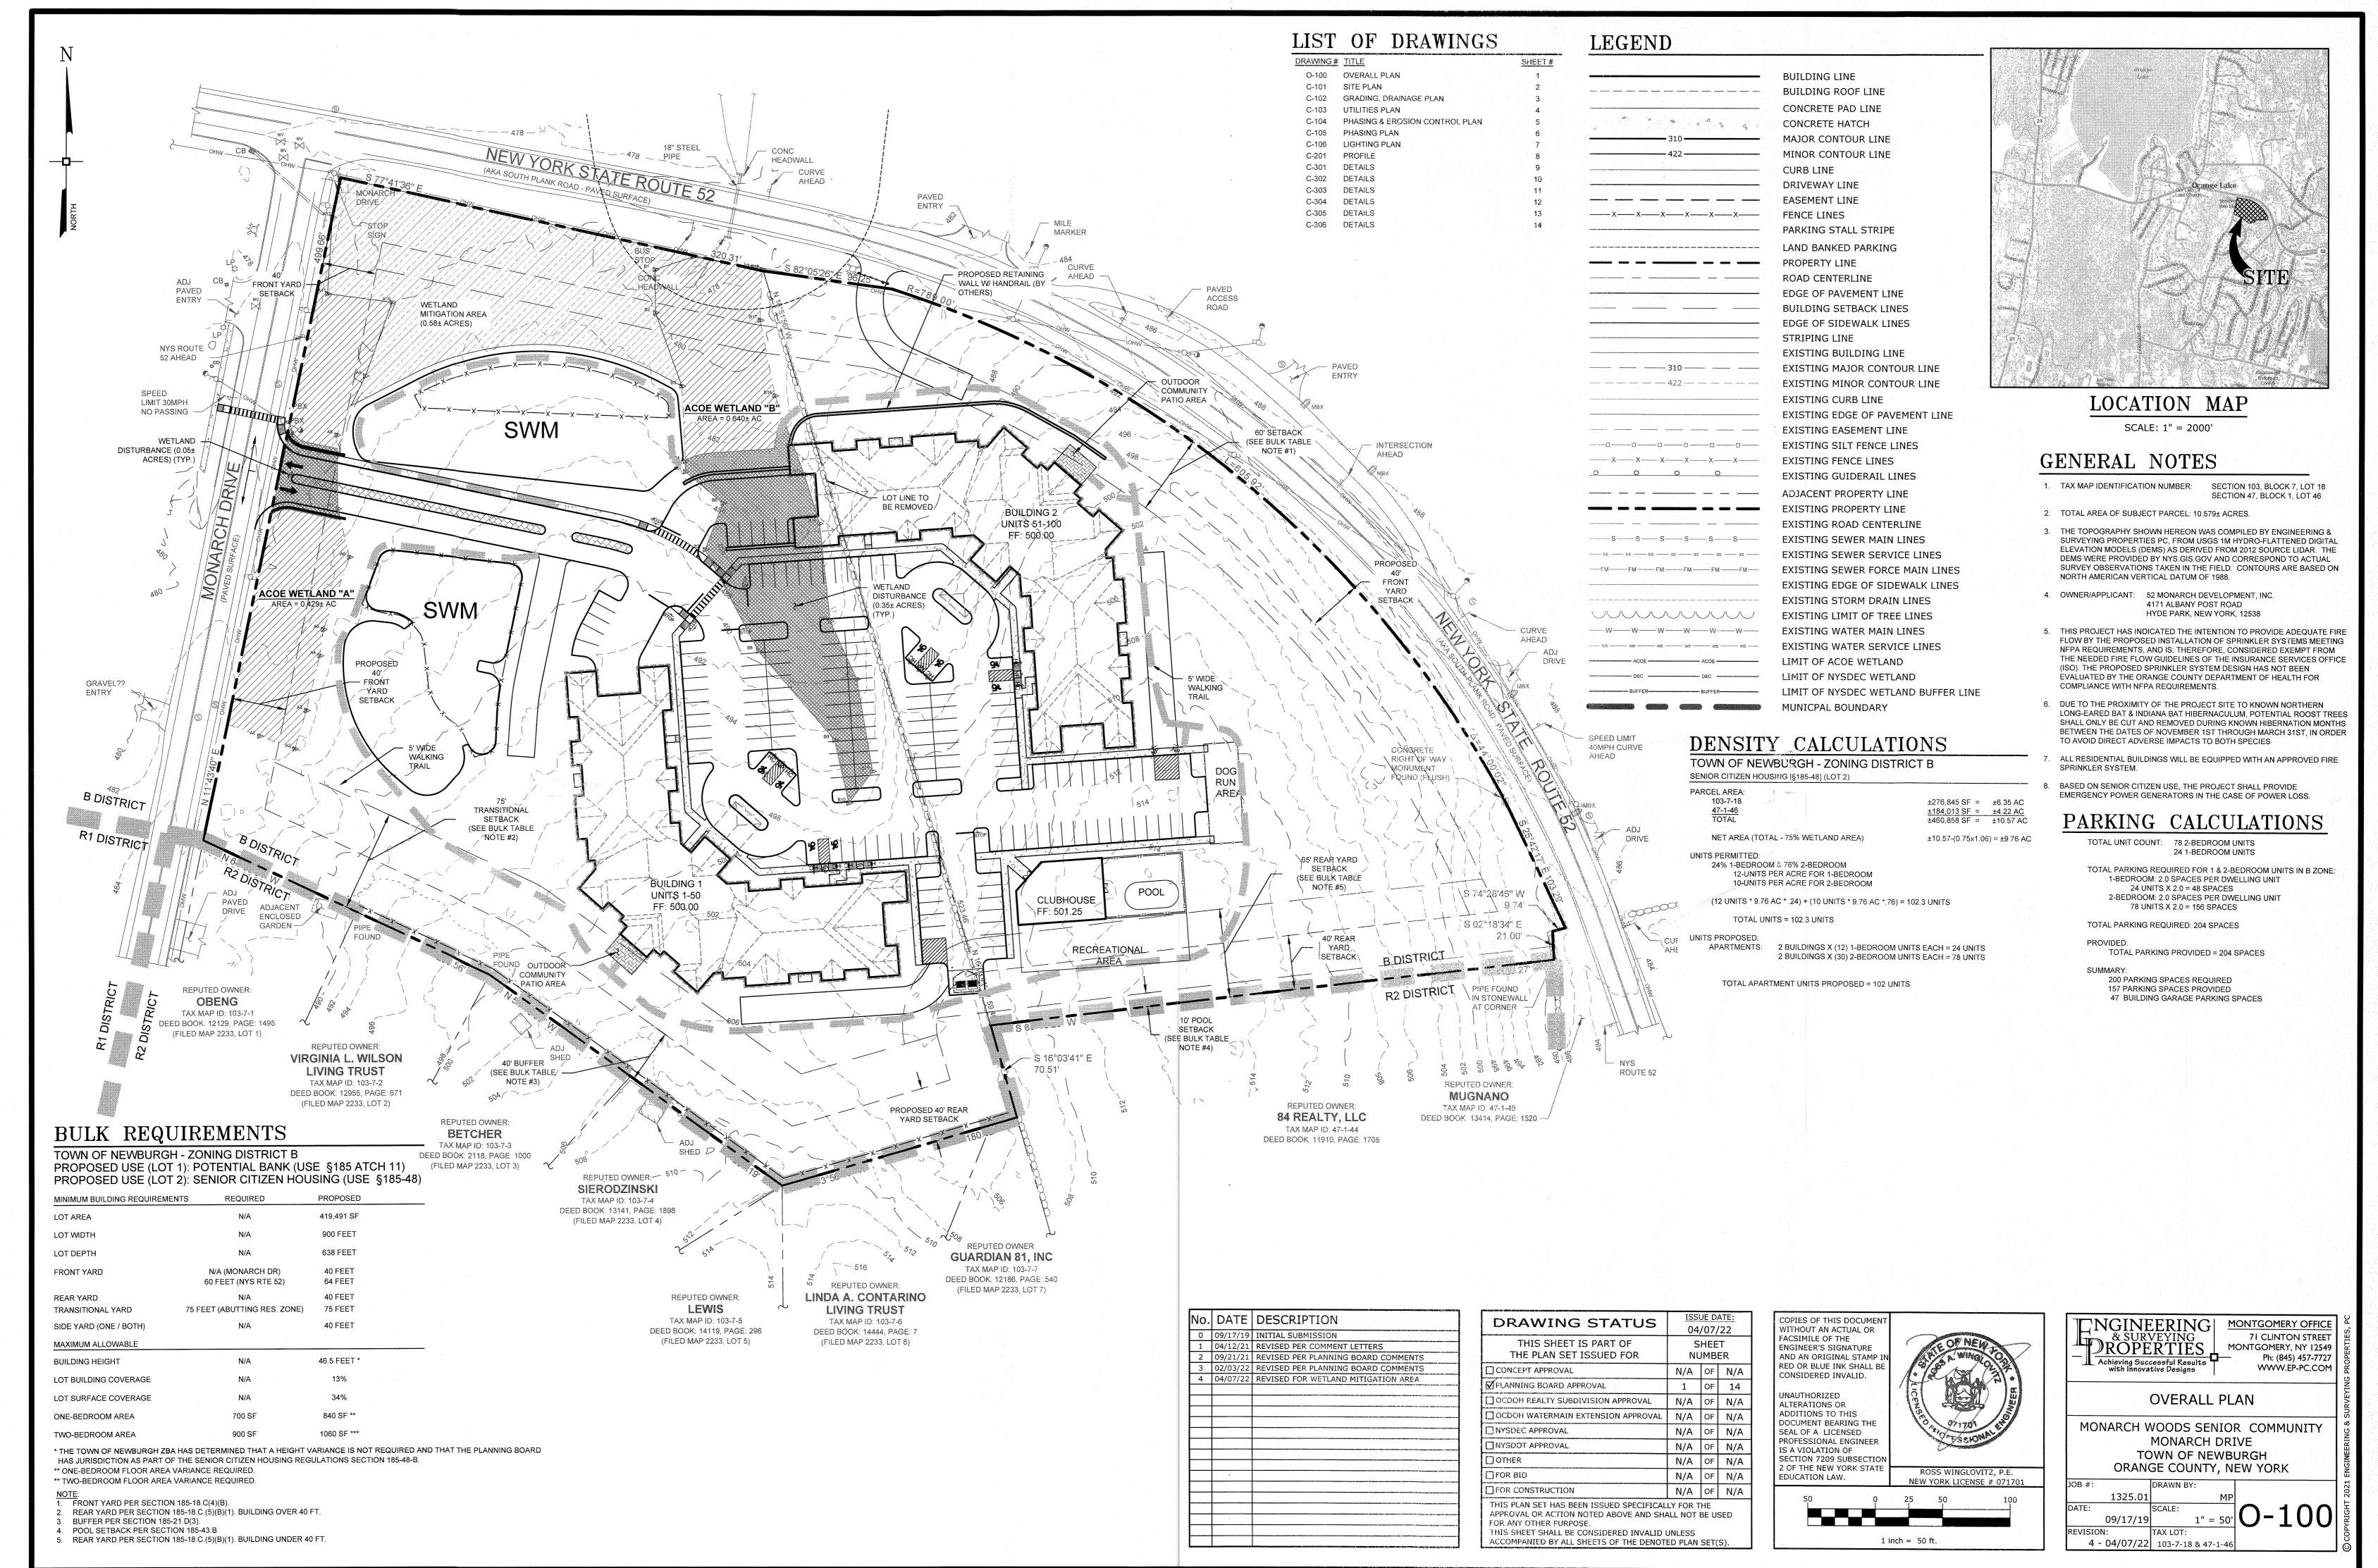


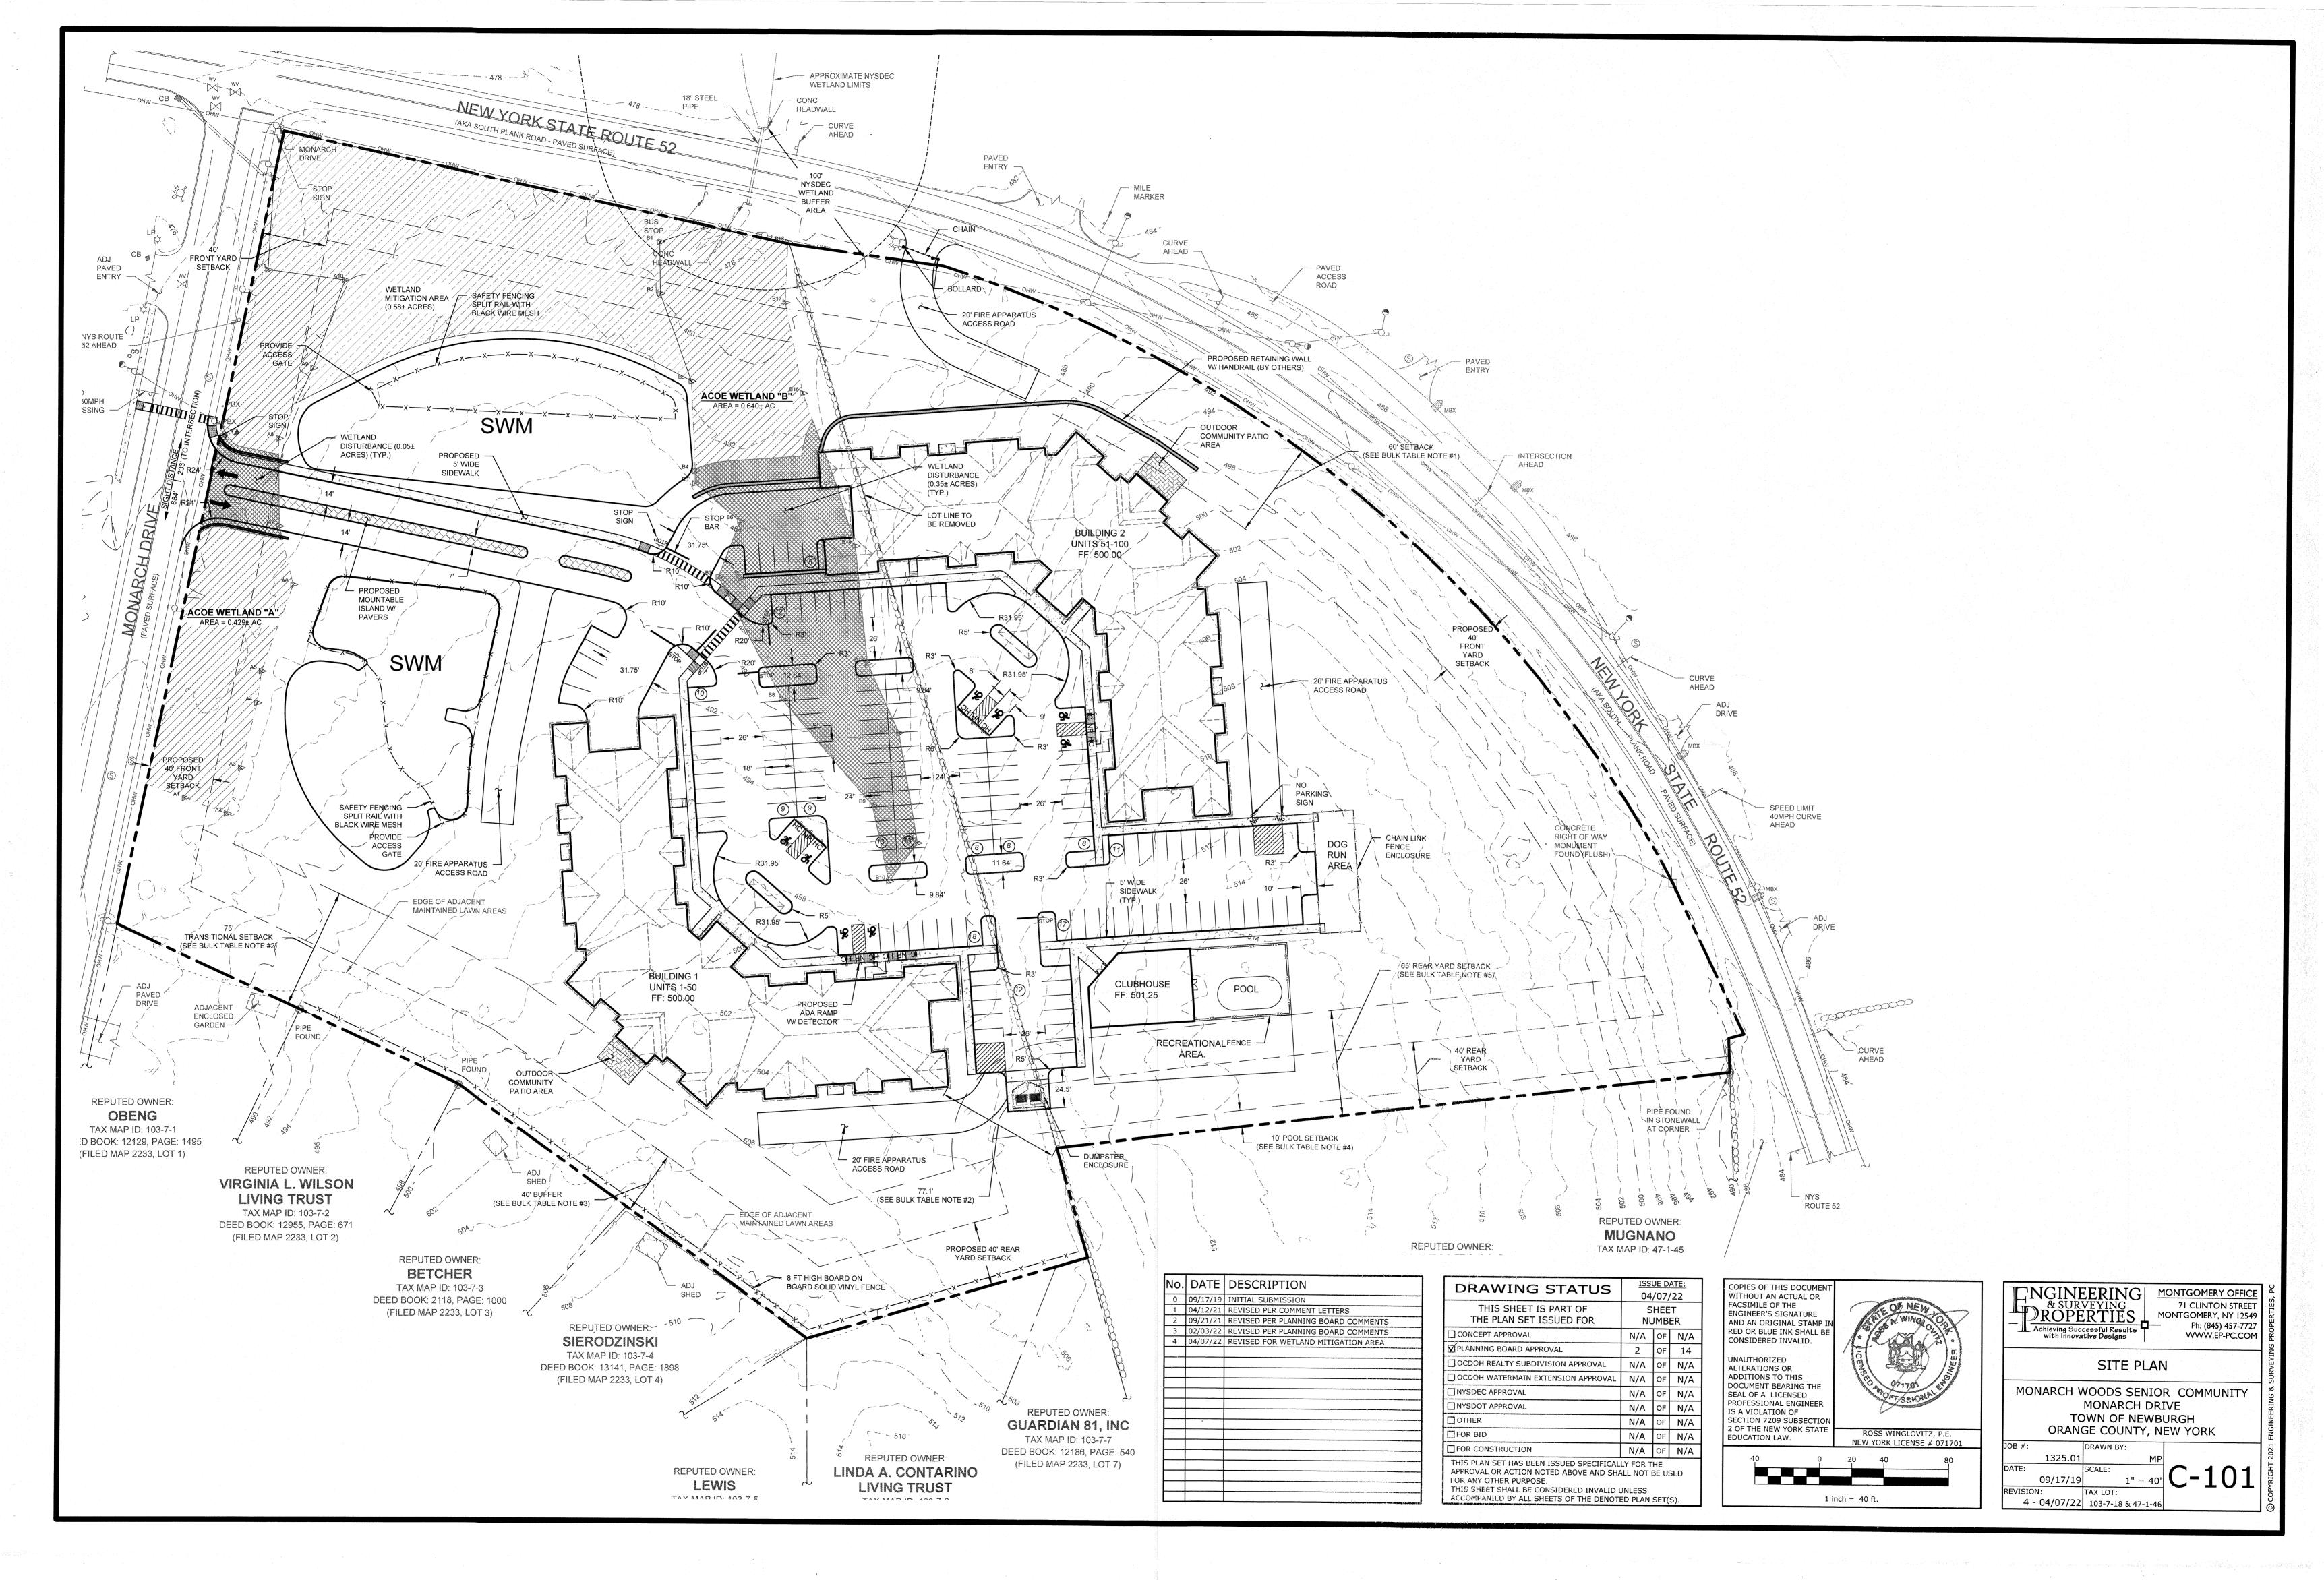

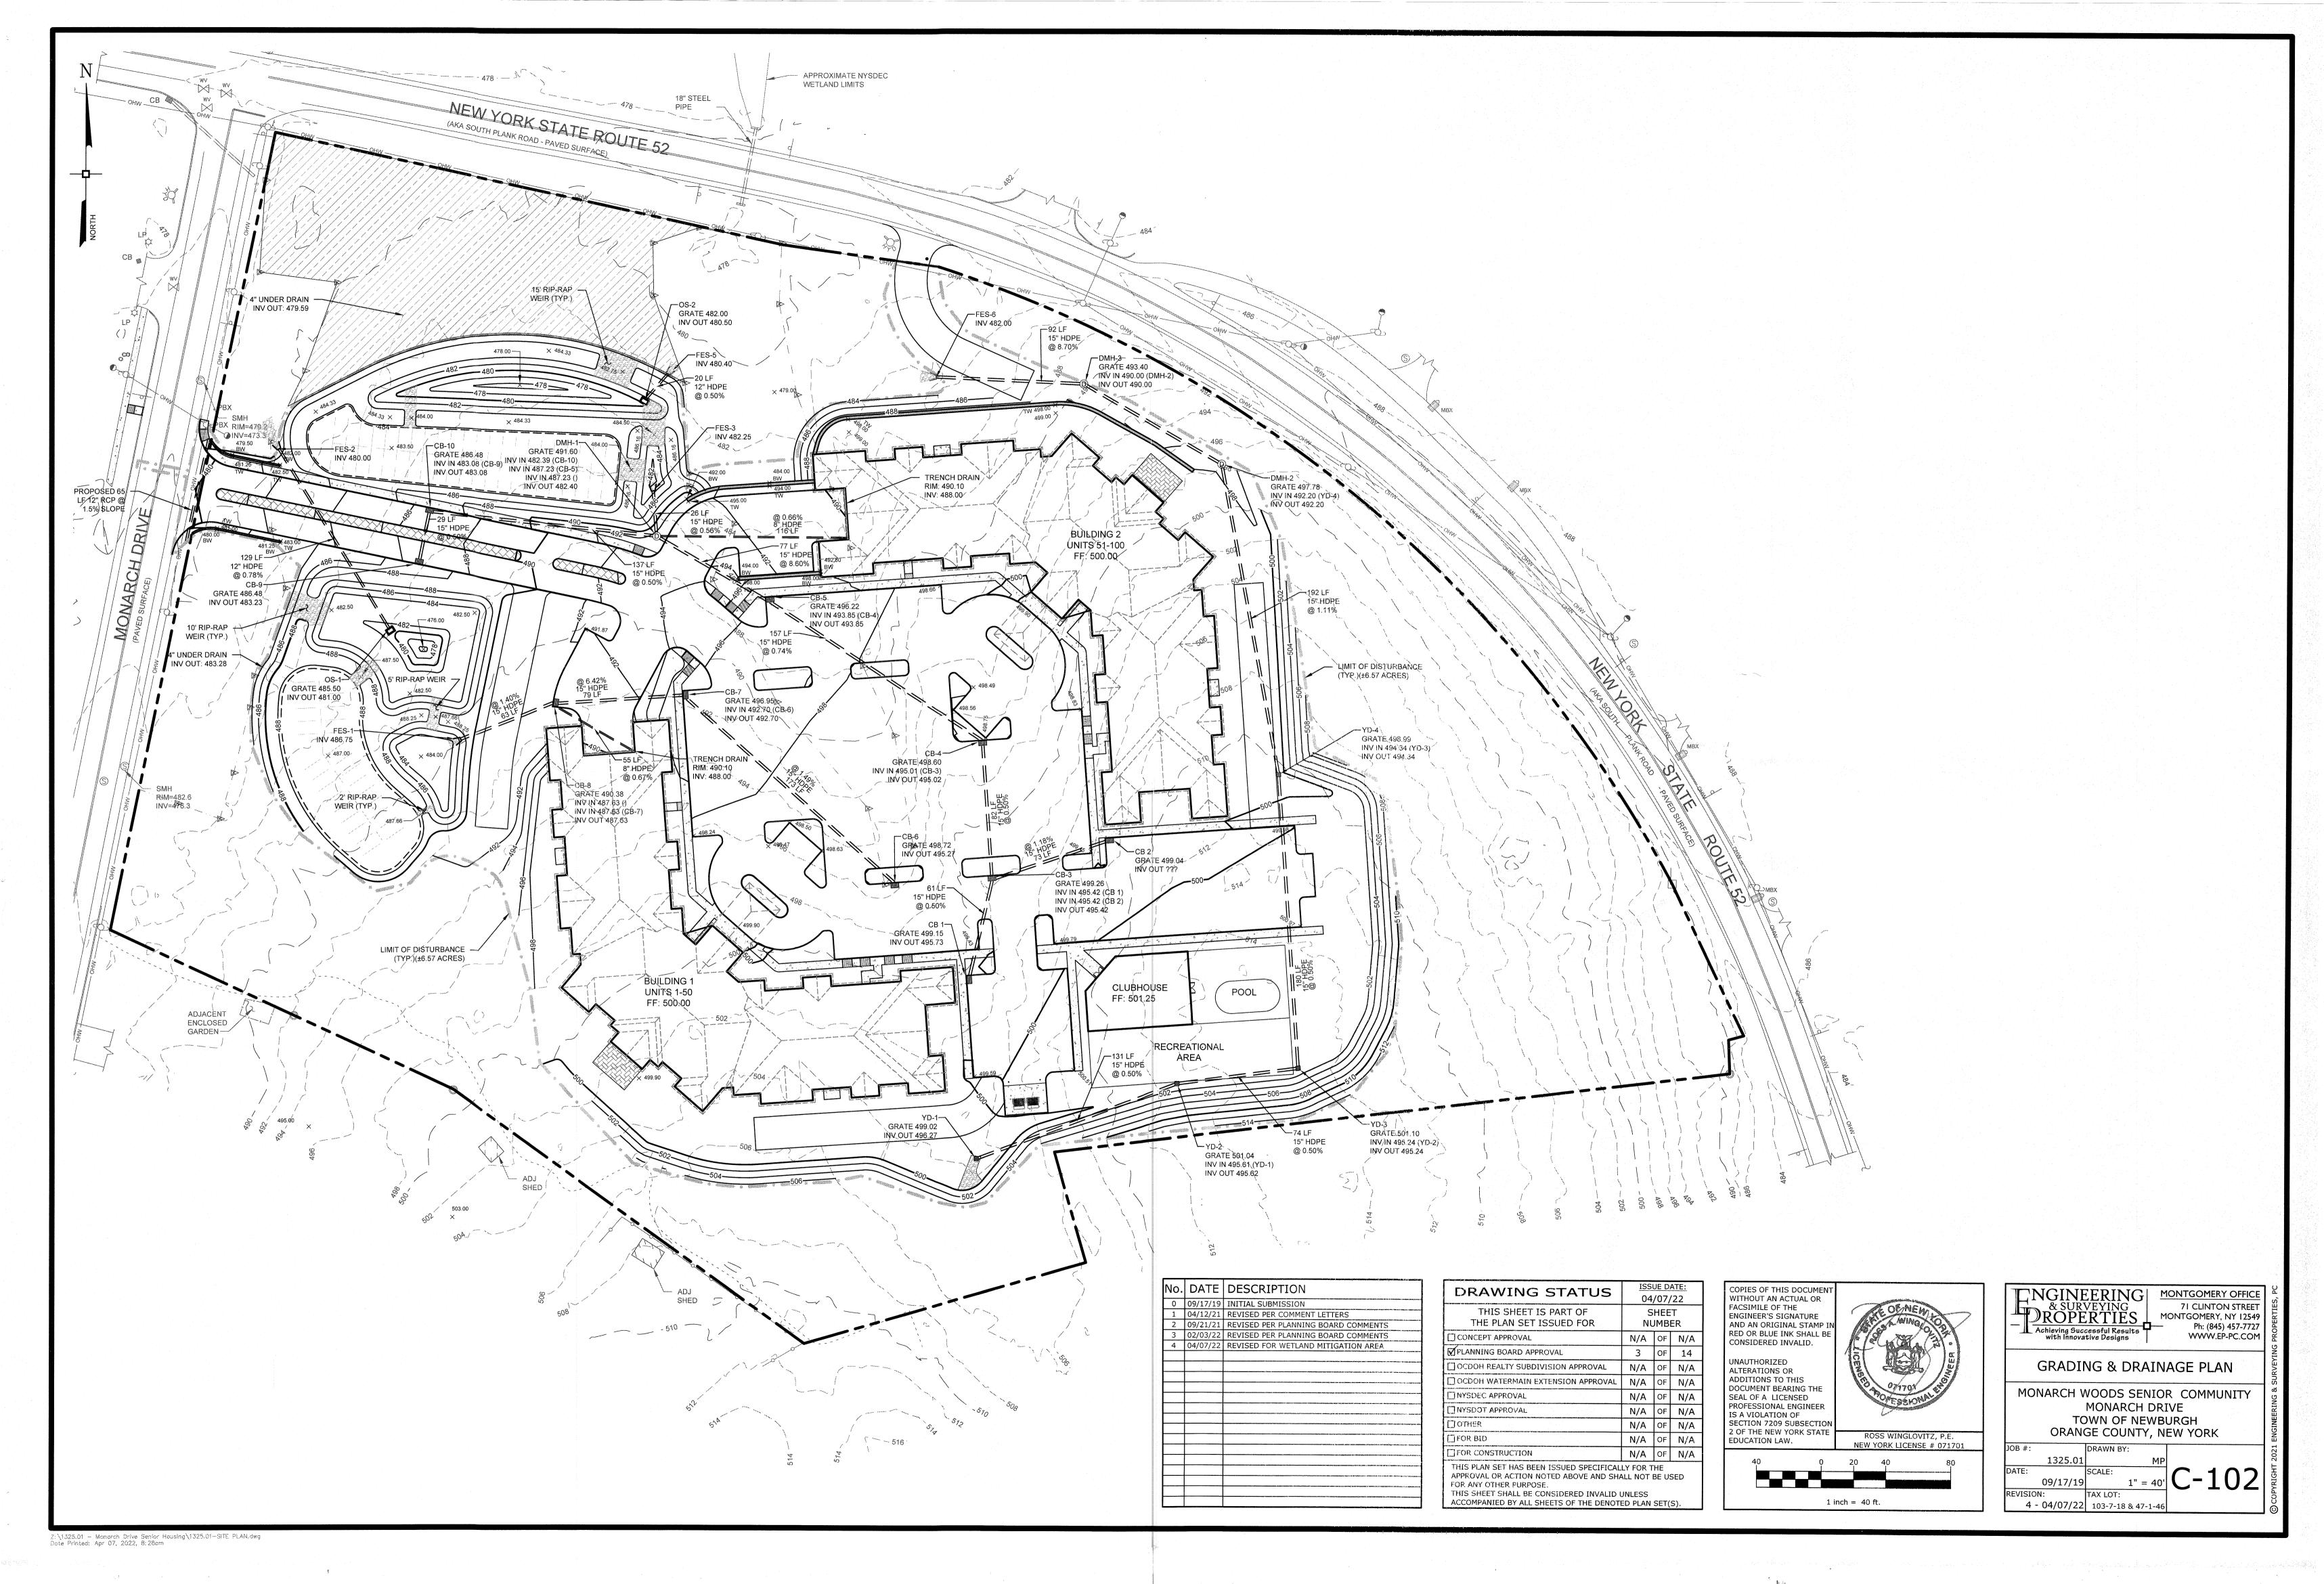

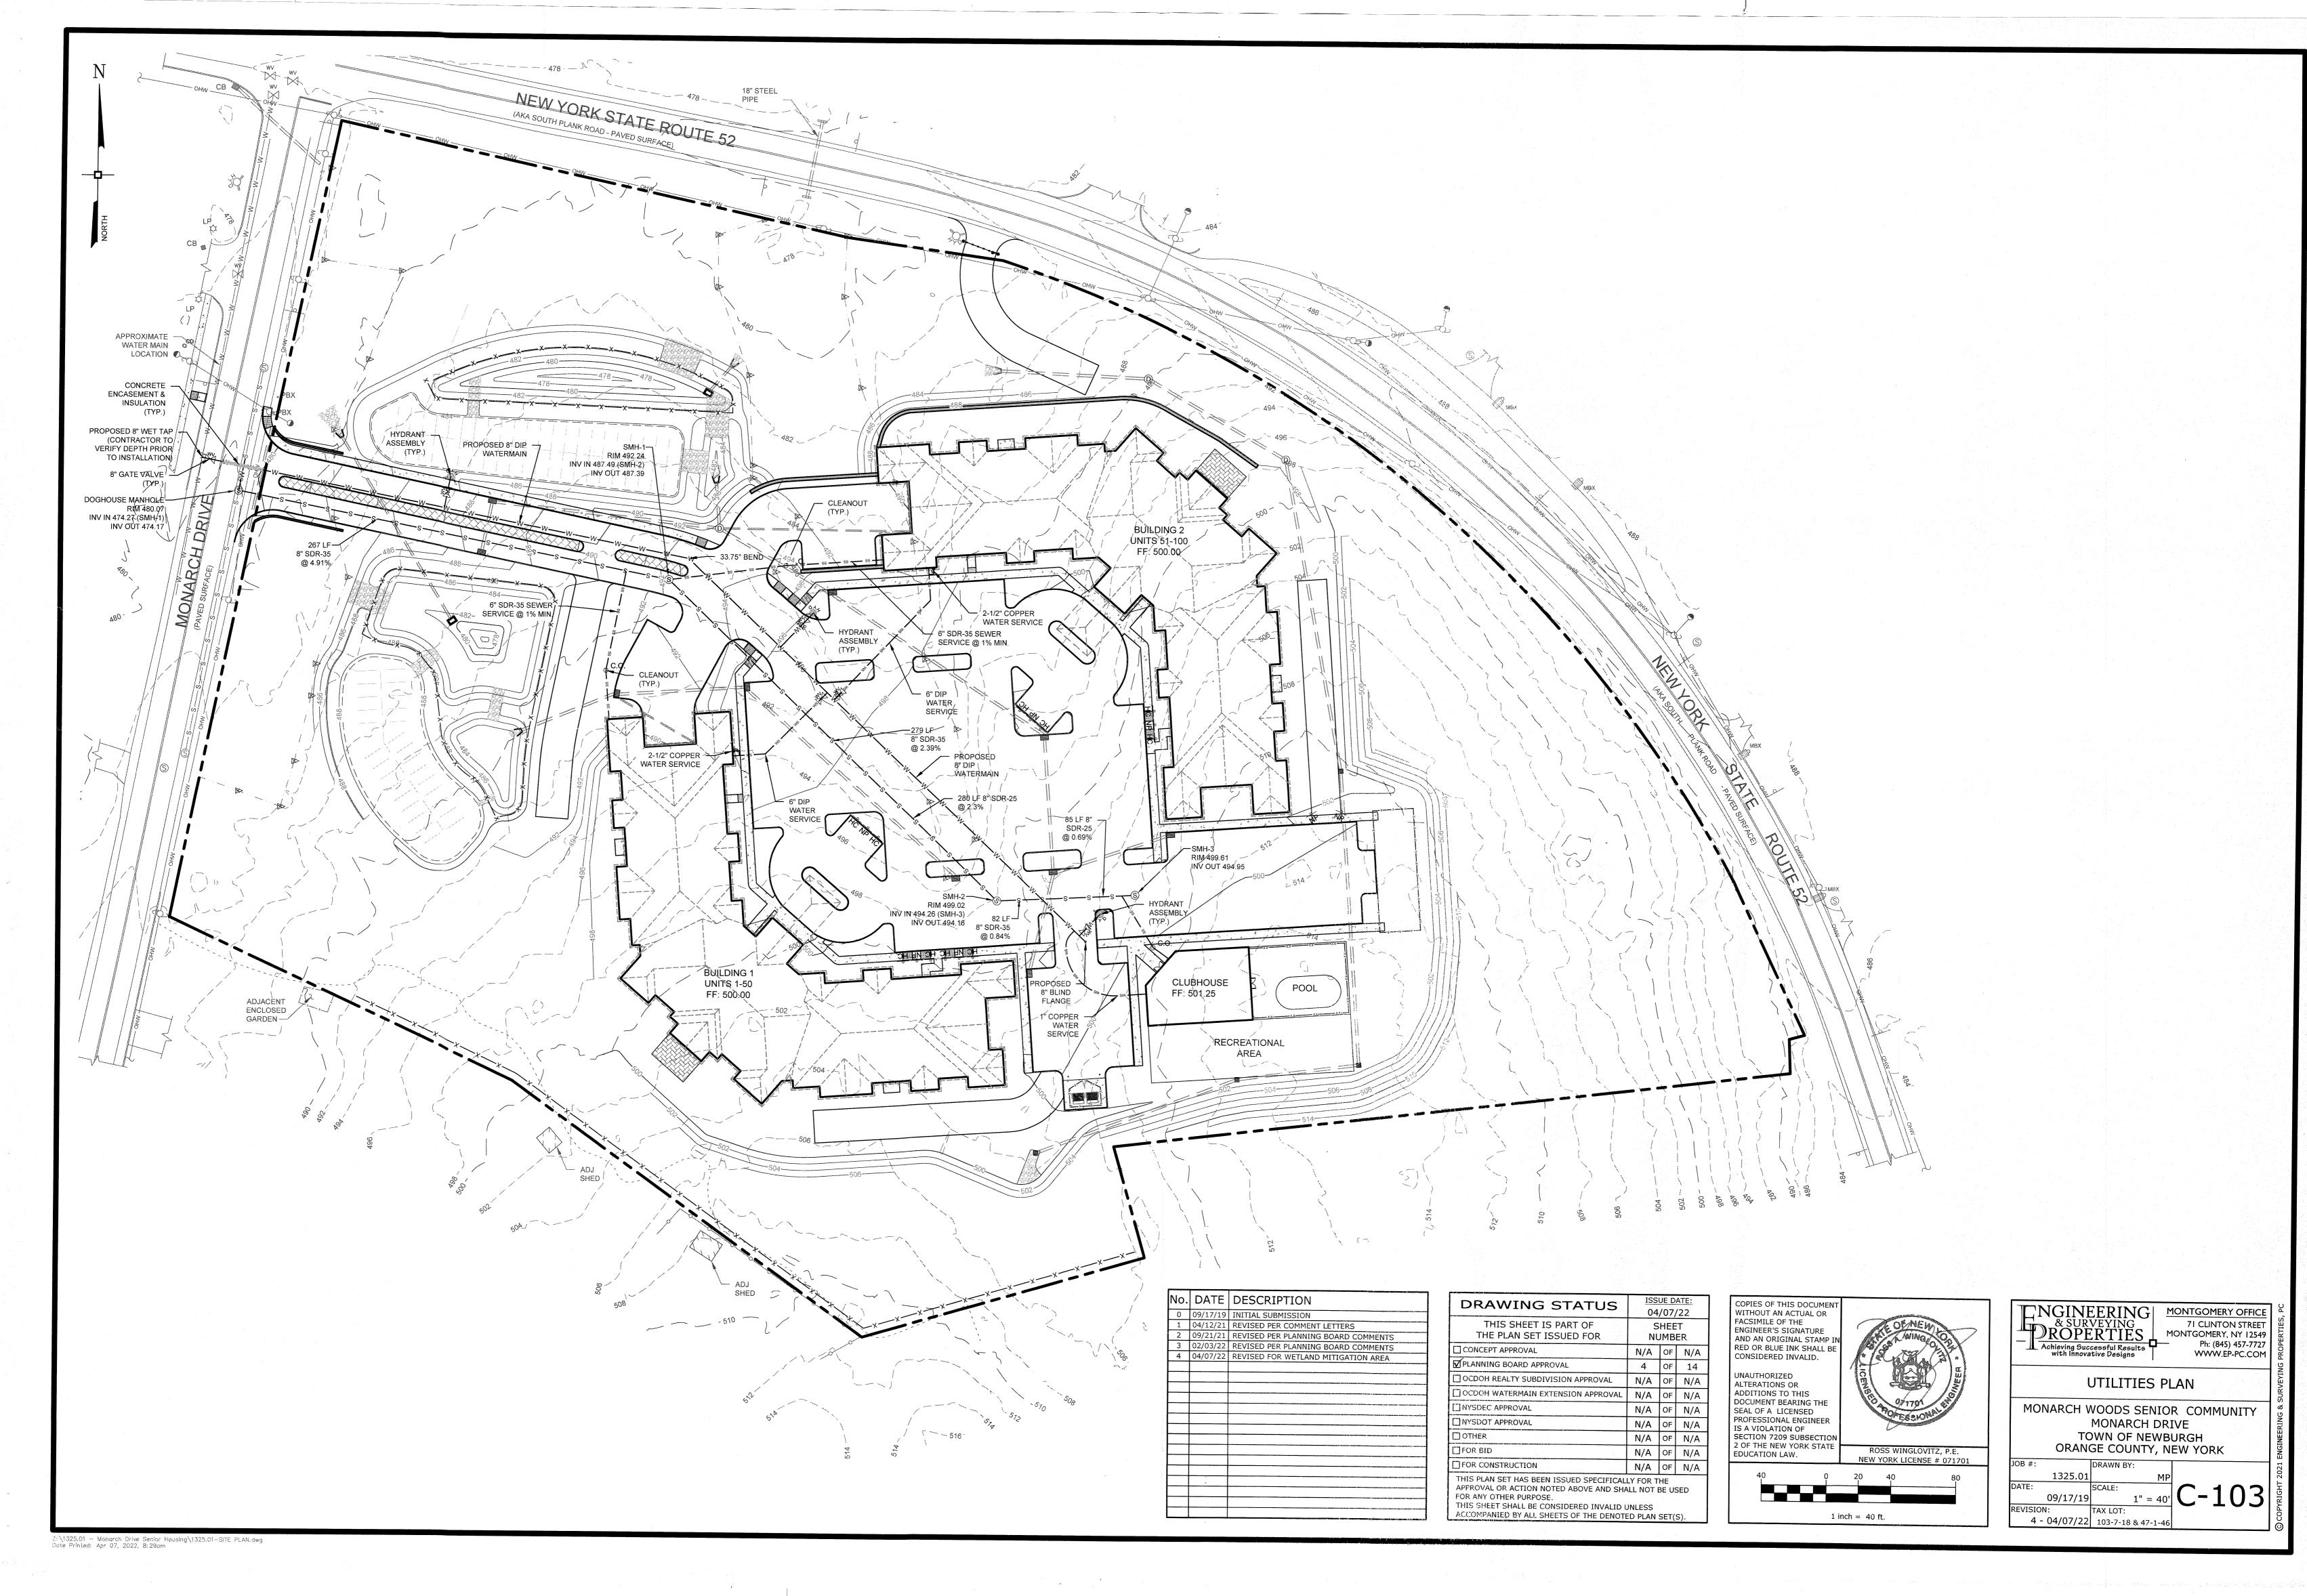

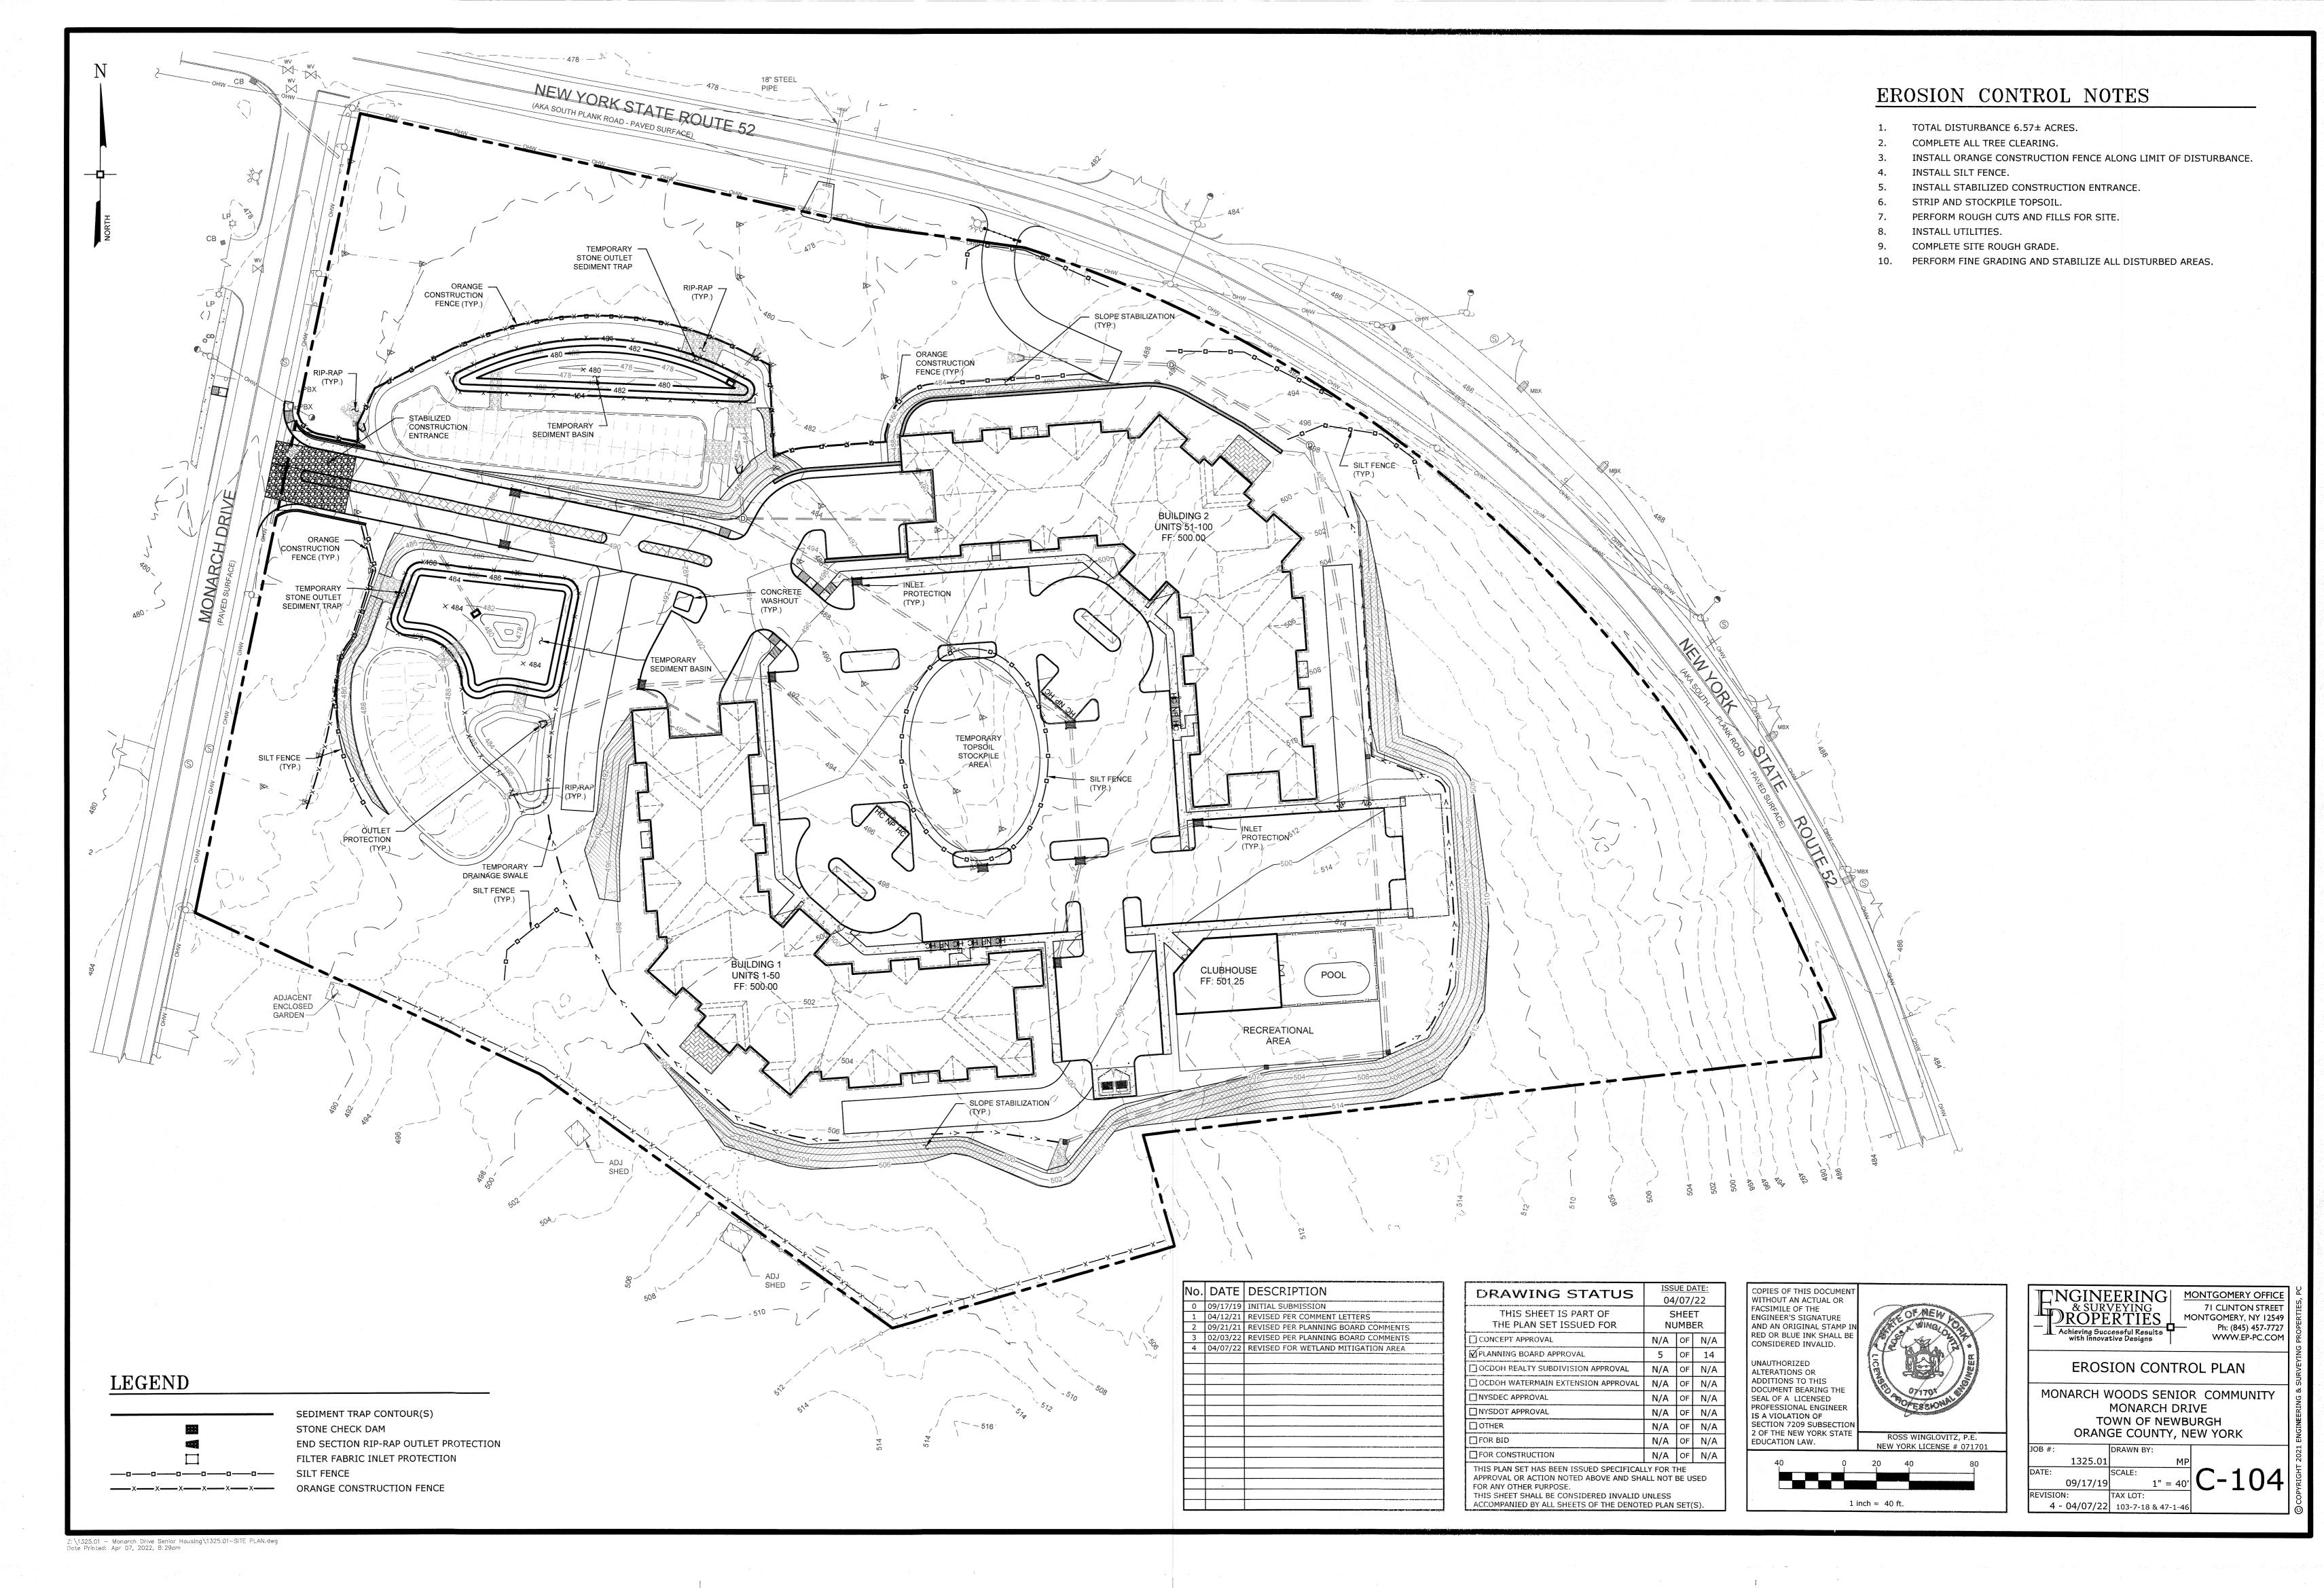


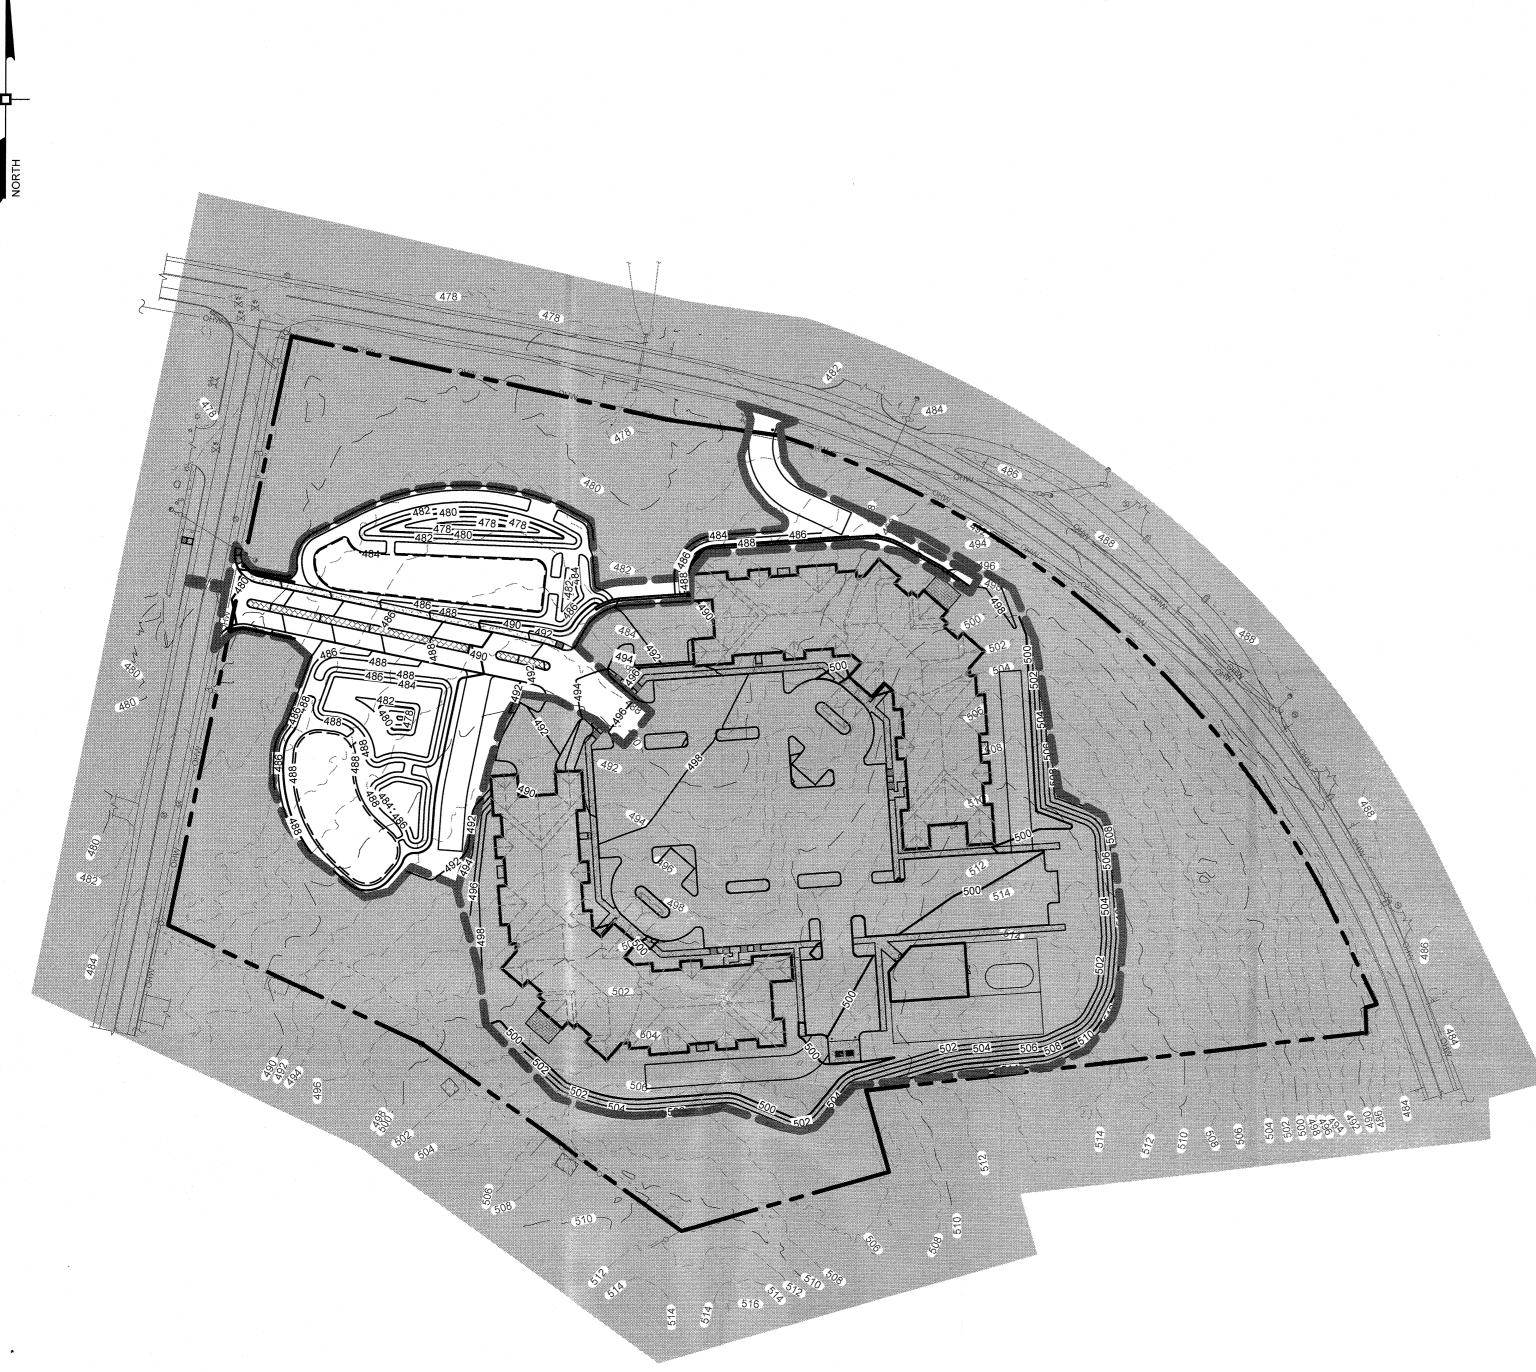



EARTHWORK PHASING NOTES

- 1. TOTAL AREA OF DISTURBANCE IS CALCULATED AT ± 6.57 ACRES. SITE PREPARATION ACTIVITIES SHALL BE PLANNED TO MINIMIZE THE AREA AND DURATION OF SOIL DISTURBANCE. THE PROJECT IS PROPOSED TO BE BUILT IN PHASES TO LIMIT THE AMOUNT OF DISTURBANCE AT ANY ONE TIME. THE TOTAL SITE DISTURBANCE WILL BE ±6.57 ACRES, HOWEVER; THE PROJECT IS PROPOSED TO BE CONSTRUCTED IN 2 PHASES TO ENSURE THAT THERE WILL NOT BE MORE THAN 5 ACRES OF DISTURBANCE AT ANY ONE TIME.
- 2. AS MANY OF THE PHASES WILL REQUIRE DISTURBANCE OF THE SAME AREA IN MULTIPLE PHASES, THE TOTAL DISTURBANCE OF ALL THE PHASES WILL BE GREATER THAN THE ACTUAL DISTURBANCE. AS CONSTRUCTION PROGRESSES WITHIN EACH PHASE, DISTURBED AREAS WILL BE STABILIZED AND IN AN ATTEMPT TO ACHIEVE CONTINUITY OF CONSTRUCTION AND MAXIMIZE EFFICIENCY OF EARTHWORK, UTILITIES, PAVING, ETC., THERE ARE SEVERAL AREAS THAT WILL BE DISTURBED IN MULTIPLE PHASES AND HAVE BEEN ACCOUNTED FOR IN THE OVERALL DISTURBANCE AREA OF EACH PHASE. THE TOTAL AREA OF DISTURBANCE IS ±6.57 AC. BUT AS NOTED PREVIOUSLY EACH PHASE MAY CONTAIN OVERLAPPING AREAS. THE PHASING PLAN DEVELOPED INCLUDES THE FOLLOWING PHASES AND AREAS.
- 2.1. PHASE 1 SHALL CONSIST OF CONSTRUCTION OF THE PRIVATE ROADWAY ENTRANCE, RETAINING WALLS, TEMPORARY DIVERSION SWALE AND SEDIMENT BASIN. THE ROADWAY CONSTRUCTION SHALL CONSIST OF EARTHWORK CUTS AND FILLS AS NECESSARY TO ESTABLISH SUBGRADE AS WELL AS INSTALLATION OF UTILITIES WITHIN THE ROADWAY
- 2.2. PHASE 2 SHALL CONSIST OF CONSTRUCTION OF THE TWO (2) APARTMENT BUILDINGS, ASSOCIATED PARKING AND ROADWAYS, REMAINING SEWER & WATER MAINS. UPON COMPLETION AND STABILIZATION OF ROADWAYS AND PARKING AREAS, THE PERMANENT STORMWATER FACILITIES SHALL BE CUT TO FINAL GRADE. CARE SHALL BE TAKEN TO ENSURE THAT THE BIO-RETENTION BASIN IS NOT CUT TO FINAL GRADE DURING CONSTRUCTION AND SHALL ONLY BE CUT TO FINAL GRADE UPON STABILIZATION OF THE BUILDING, RECREATIONAL AREAS, ROADWAY, PARKING AND LOADING AREAS.
- 2.3. THE MAXIMUM DISTURBANCE AREA IN EACH OF THE CONSTRUCTION PHASING AREAS ARE AS FOLLOWS: PHASE 1 - ±1.85 AC. PHASE 2 - ±4.74 AC.
- 3. UPON THE COMPLETION OF THE EARTHWORK PHASES, CONSTRUCTION WILL CONTINUE WITH INSTALLATION OF UTILITIES, PAVEMENT AREAS AND BUILDING CONSTRUCTION, ETC. AND MAINTAIN A MAXIMUM DISTURBANCE AREA OF 5 ACRES. STORMWATER FACILITIES UTILIZED AS TEMPORARY SEDIMENT BASINS SHALL ONLY BE FINALIZED AFTER ALL CONTRIBUTORY AREA TO EACH RESPECTIVE FACILITY HAS BEEN STABILIZED.

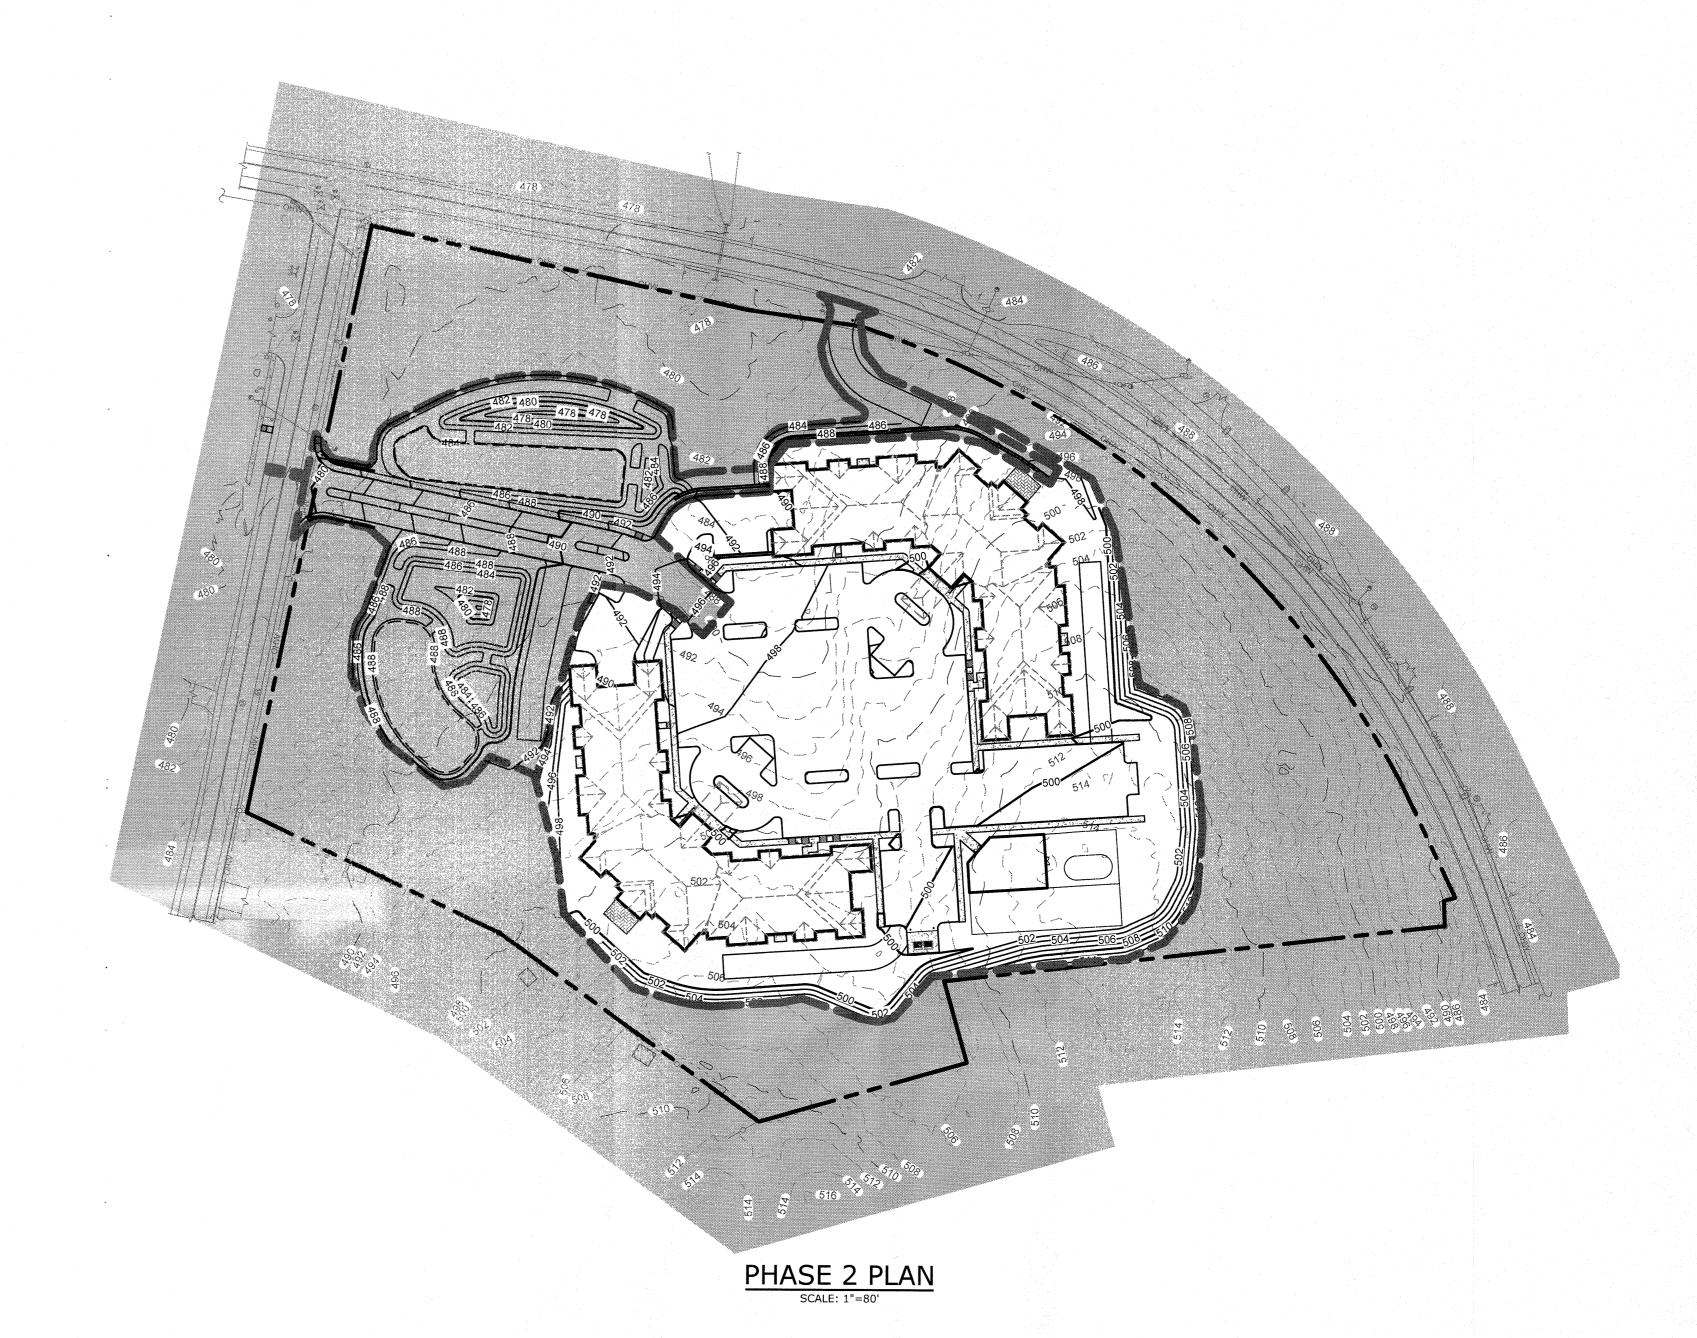

No.	DATE	DESCRIPTION
0	09/17/19	INITIAL SUBMISSION
1	04/12/21	REVISED PER COMMENT LETTERS
2	09/21/21	REVISED PER PLANNING BOARD COMMENTS
3	02/03/22	REVISED PER PLANNING BOARD COMMENTS
4	04/07/22	REVISED FOR WETLAND MITIGATION AREA
		Since Spines
		· ·
		The state of the s


DRAWING STATUS		UE D.	
THIS SHEET IS PART OF THE PLAN SET ISSUED FOR	SHEET NUMBER		
CONCEPT APPROVAL	N/A	OF	N/A
☑PLANNING BOARD APPROVAL	6	OF	14
OCDOH REALTY SUBDIVISION APPROVAL	N/A	OF	N/A
OCDOH WATERMAIN EXTENSION APPROVAL	N/A	OF	N/A
NYSDEC APPROVAL	N/A	OF	N/A
NYSDOT APPROVAL	N/A	OF	N/A
OTHER	N/A	OF	N/A
☐FOR BID	N/A	OF	N/A
☐FOR CONSTRUCTION	N/A	OF	N/A
THIS PLAN SET HAS BEEN ISSUED SPECIFICAL APPROVAL OR ACTION NOTED ABOVE AND SHAFOR ANY OTHER PURPOSE. THIS SHEET SHALL BE CONSIDERED INVALID ACCOMPANIED BY ALL SHEETS OF THE DENOT	ALL NOT	BE US	


COPIES OF THIS DOCUMENT WITHOUT AN ACTUAL OR FACSIMILE OF THE ENGINEER'S SIGNATURE AND AN ORIGINAL STAMP IN RED OR BLUE INK SHALL BE CONSIDERED INVALID. UNAUTHORIZED ALTERATIONS OR ADDITIONS TO THIS DOCUMENT BEARING THE SEAL OF A LICENSED PROFESSIONAL ENGINEER IS A VIOLATION OF SECTION 7209 SUBSECTION 2 OF THE NEW YORK STATE	LICENSE OF NEW ON THE OFFICE OF NEW ON THE OFFICE OF NEW ON THE OFFICE OF THE OFFICE OFFICE OF THE OFFICE OFFICE OFFICE OFFICE O
EDUCATION LAW.	ROSS WINGLOVITZ, P.E.
EDUCATION LAW.	NEW YORK LICENSE # 071701

1 inch = 80 ft.

ROPE & SUR	EERING VEYING ERTIES Cessful Results tive Designs	MONTGOMERY OFFIC 71 CLINTON STREE MONTGOMERY, NY 1254 Ph: (845) 457-772 WWW.EP-PC.CO	M 72 64 T. PROPERTIES
	PHASING	PLAN	SURVEYING
TC	MONARCH DWN OF NEV		ENGINEERING &
JOB #: 1325.01	DRAWN BY:	МР	T 2021
DATE:	loose :		~

4 - 04/07/22 103-7-18 & 47-1-46

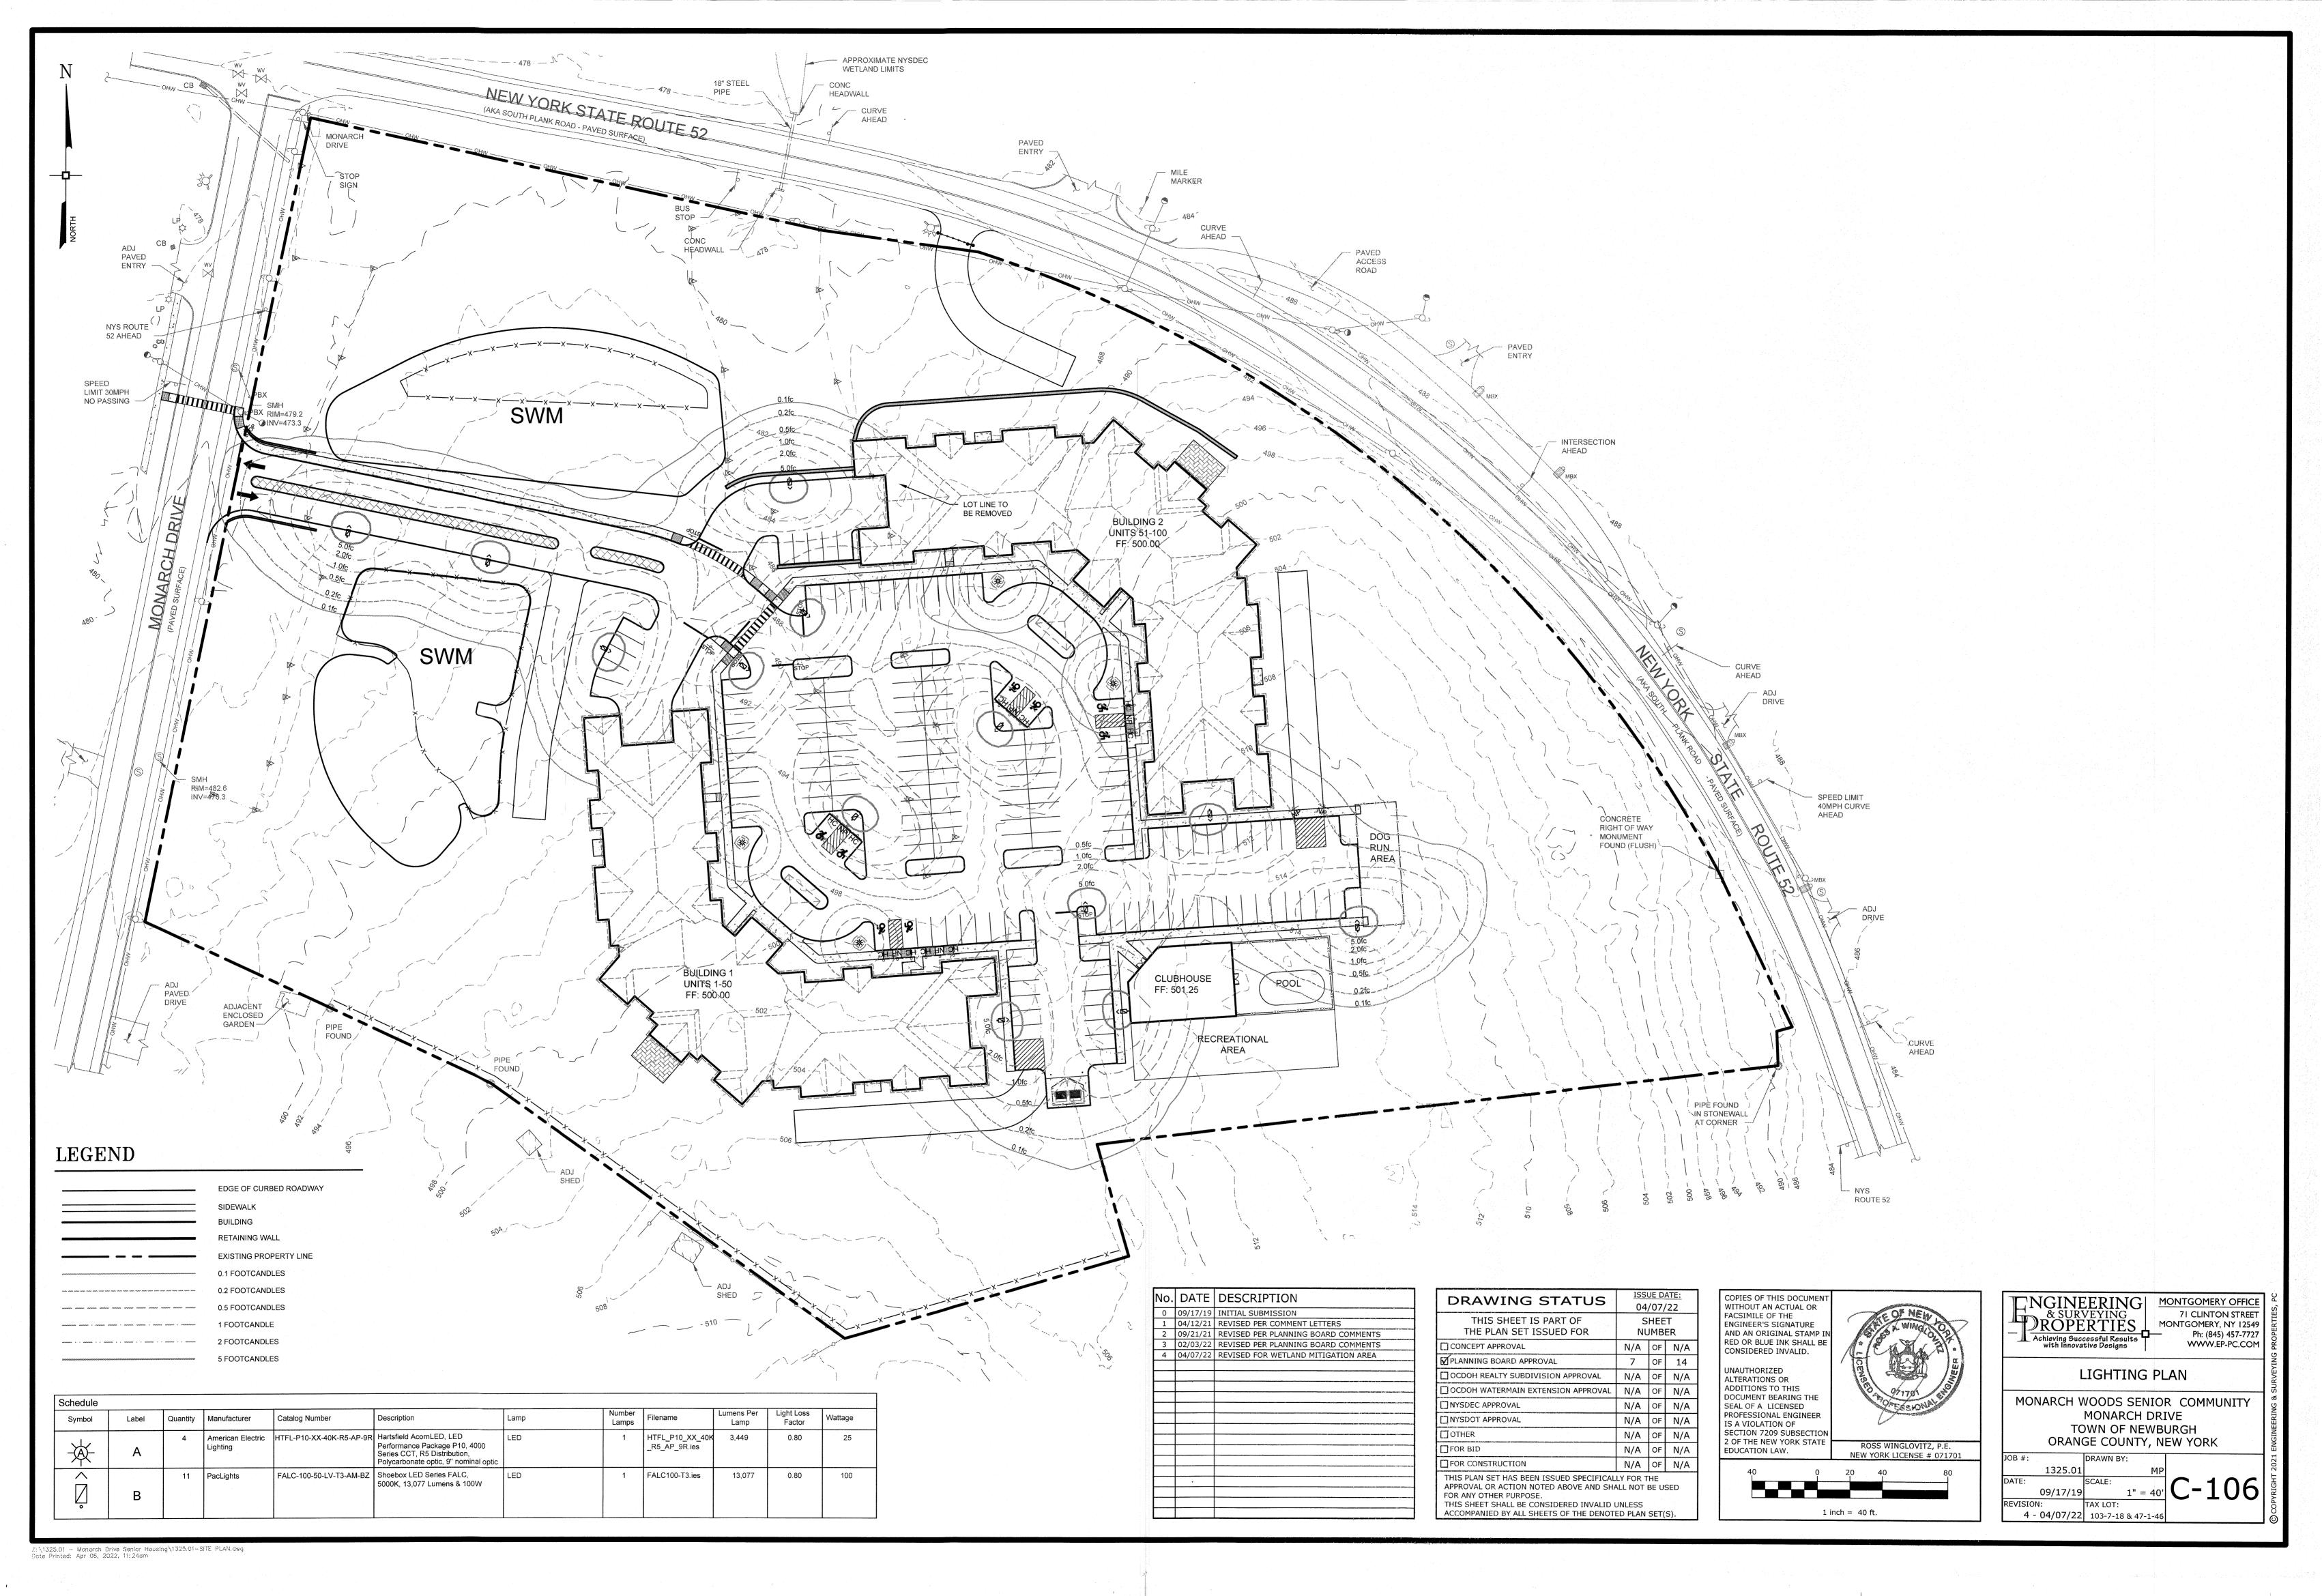


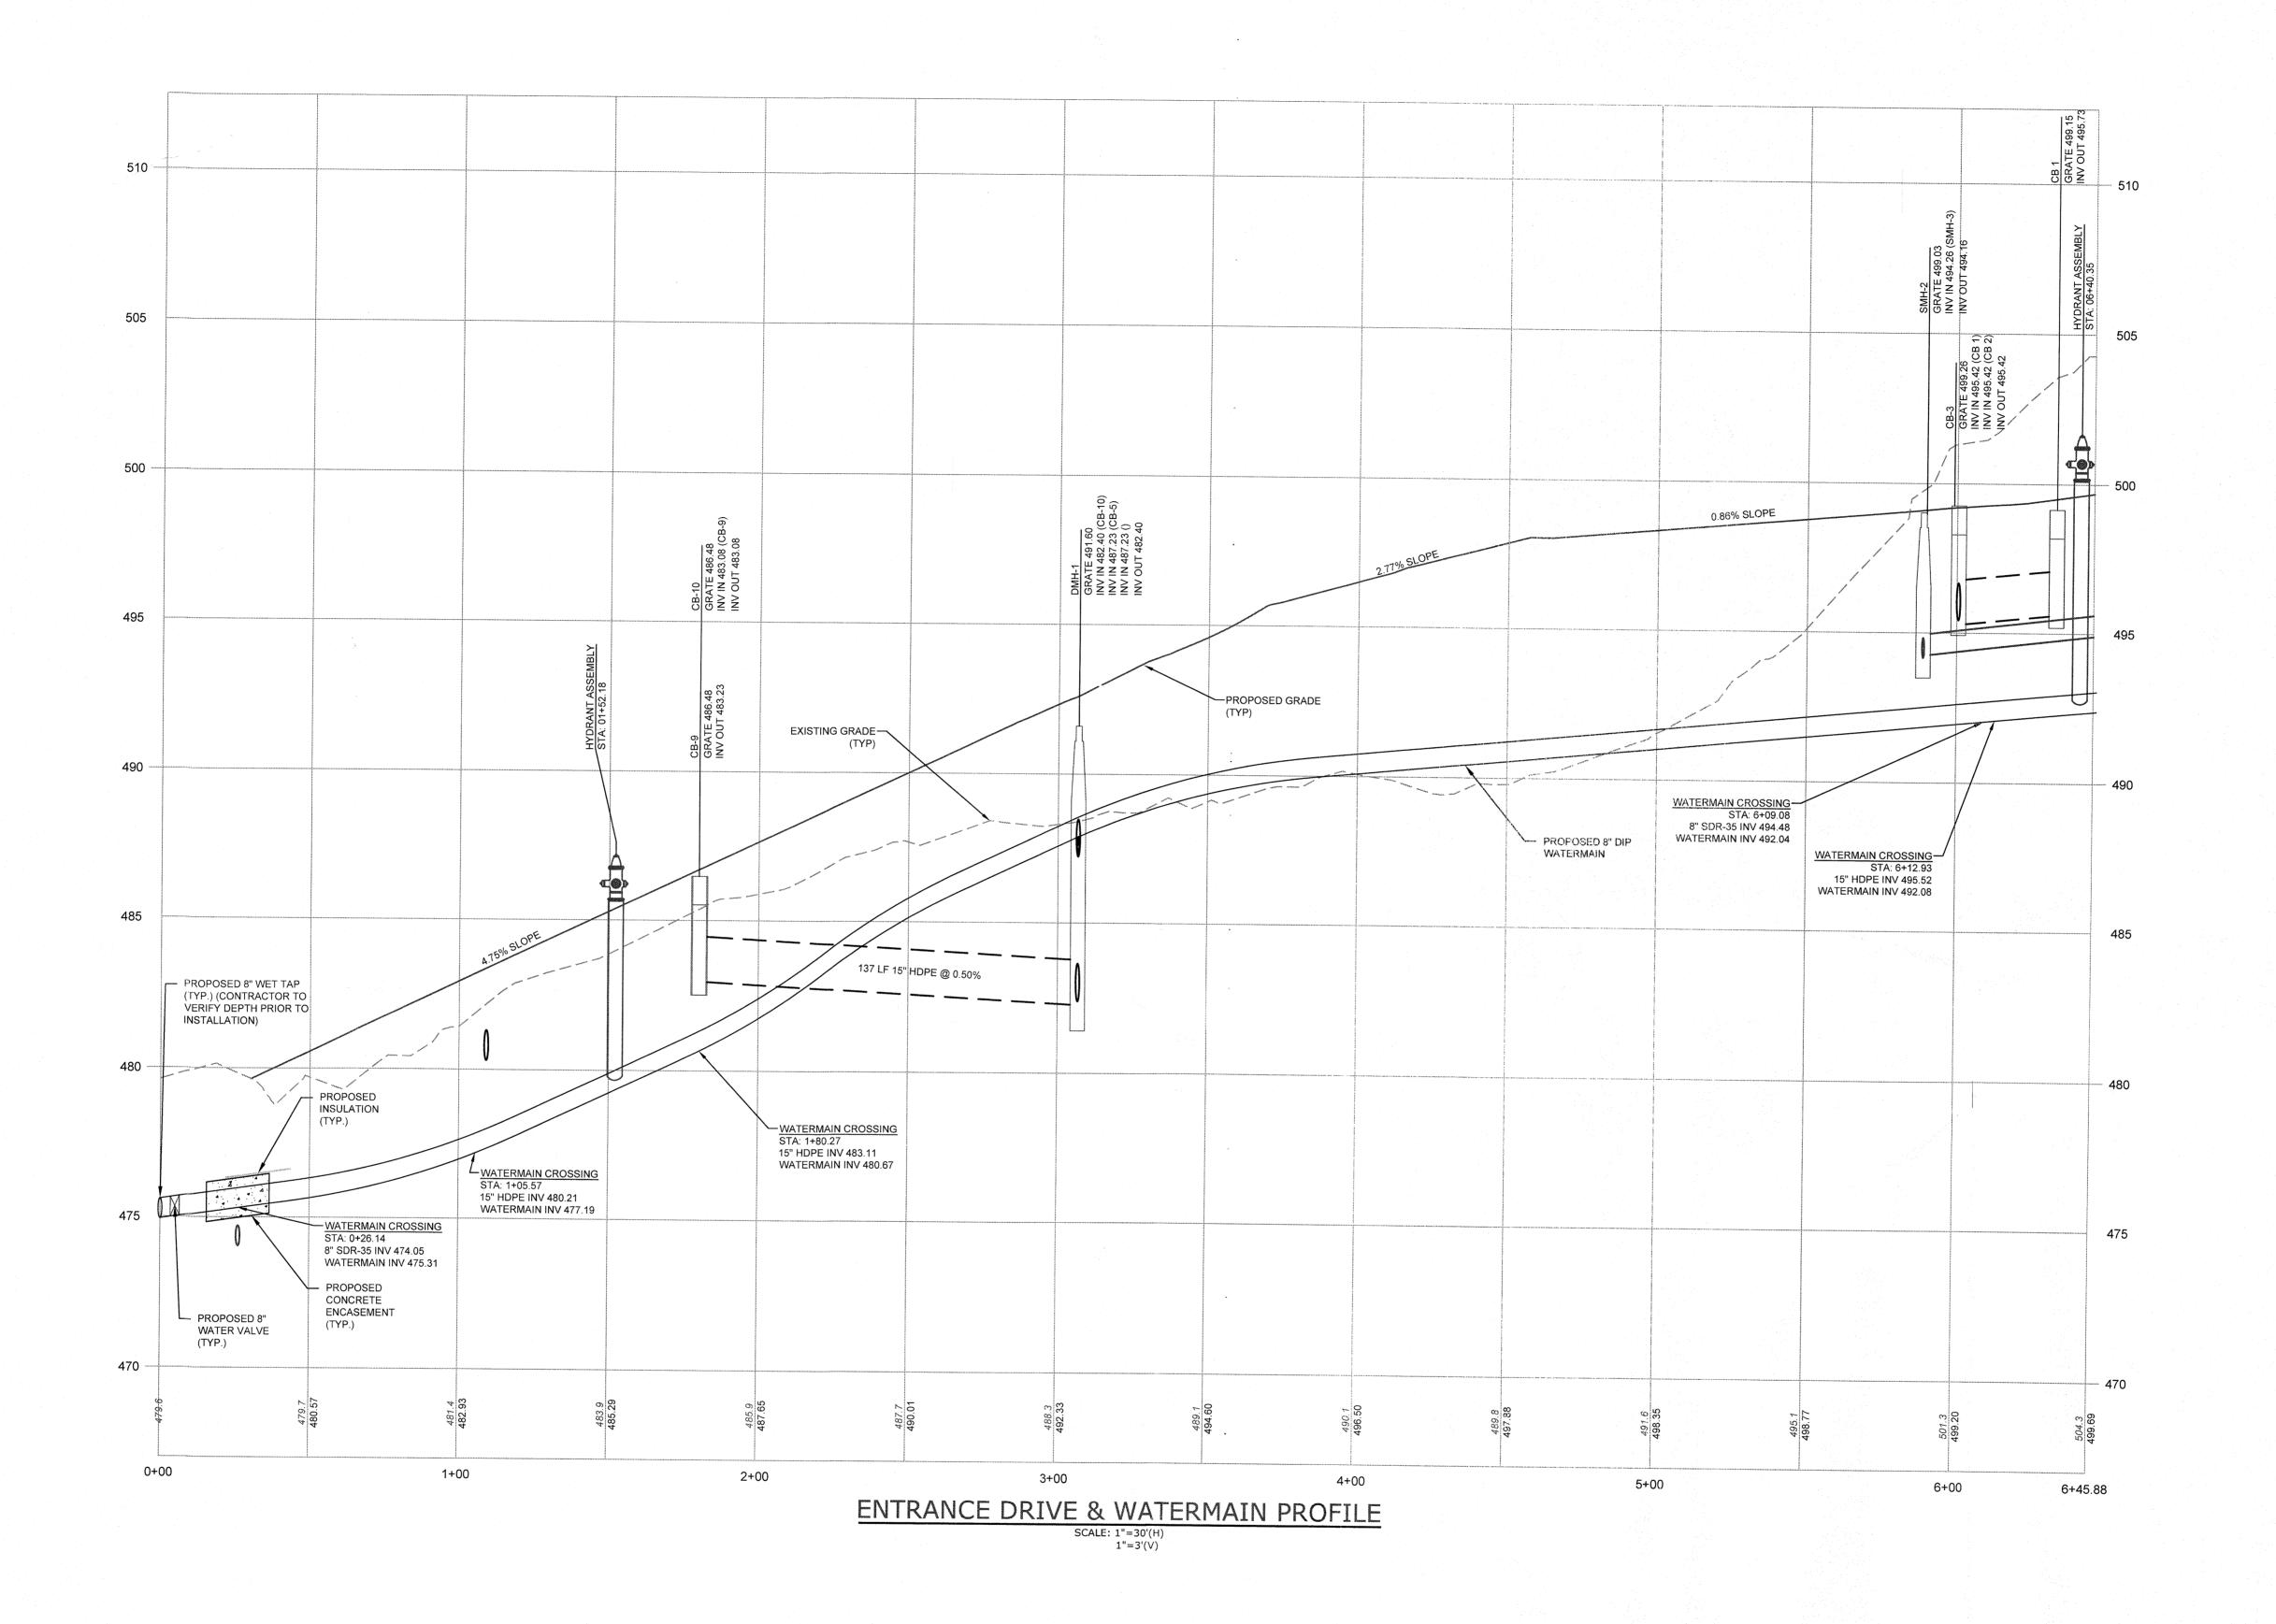

No. DATE DESCRIPTION

0 09/17/19 INITIAL SUBMISSION
1 04/12/21 REVISED PER COMMENT LETTERS
2 09/21/21 REVISED PER PLANNING BOARD COMMENTS
3 02/03/22 REVISED PER PLANNING BOARD COMMENTS
4 04/07/22 REVISED FOR WETLAND MITIGATION AREA

DRAWING STATUS	<u>ISS</u> 04			
THIS SHEET IS PART OF THE PLAN SET ISSUED FOR	S NU			
CONCEPT APPROVAL	N/A	OF	N/A	
PLANNING BOARD APPROVAL	8	OF	14	
OCDOH REALTY SUBDIVISION APPROVAL	N/A	OF	N/A	
OCDOH WATERMAIN EXTENSION APPROVAL	N/A	OF	N/A	
NYSDEC APPROVAL	N/A	OF	N/A	
NYSDOT APPROVAL	N/A	OF	N/A	
☐ O'THER	N/A	OF	N/A	
☐FOR BID	N/A	OF	N/A	
☐FOR CONSTRUCTION	N/A	OF	N/A	
THIS PLAN SET HAS BEEN ISSUED SPECIFICALLY FOR THE APPROVAL OR ACTION NOTED ABOVE AND SHALL NOT BE USED FOR ANY OTHER PURPOSE. THIS SHEET SHALL BE CONSIDERED INVALID UNLESS ACCOMPANIED BY ALL SHEETS OF THE DENOTED PLAN SET(S).				

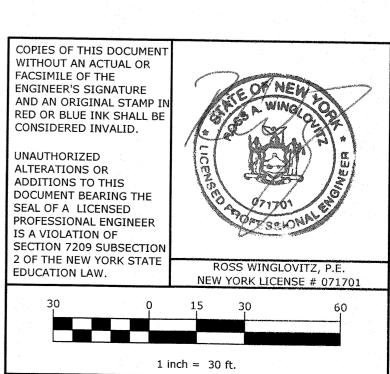

	PRO Achievi
WEER	
No.	MONAR
P.E.	OI
071701	JOB #:
60	132
	DATE:
	09/1

Achieving Successful Results with Innovative Designs

MONTGOMERY OFFICE
71 CLINTON STREET MONTGOMERY, NY 12549
Ph: (845) 457-7727
WWW.EP-PC.COM

UTILITY PROFILES

MONARCH WOODS SENIOR COMMUNITY

MONARCH DRIVE


TOWN OF NEWBURGH

ORANGE COUNTY, NEW YORK

B #: DRAWN BY:


1325.01 MP
ATE: SCALE:
09/17/19 AS SHOWN
EVISION: TAX LOT:
4 - 04/07/22 103-7-18 & 47-1-46


Z:\1325.01 - Monarch Drive Senior Housing\1325.01 PIPE NETWORK.dwg Date Printed: Apr 06, 2022, 11:36am

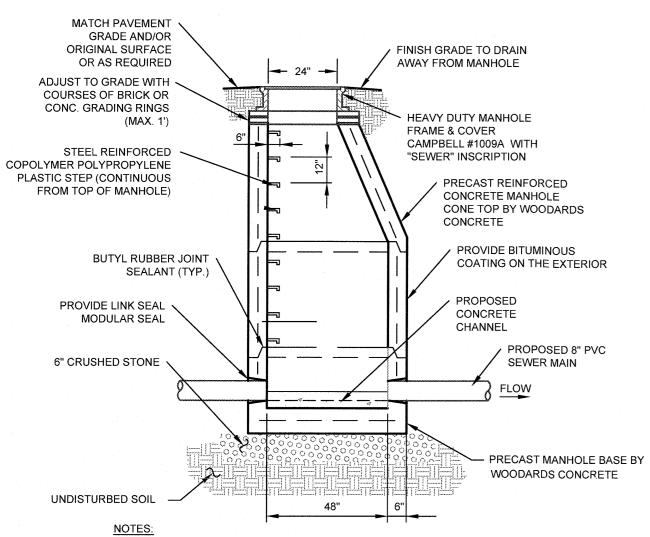

- 1. CONCRETE TO HAVE A MINIMUM COMPRESSIVE STRENGTH OF 4000 PSI @ 28 DAYS.
- 2. REINFORCEMENT TO BE IN CONFORMANCE WITH ASTM A615 GRADE 60 AND ASTM A185 GRADE 65.
- 3. ALL MANHOLES WITHIN PAVEMENT AREAS SHALL BE DESIGNED TO WITHSTAND

SEWER MANHOLE

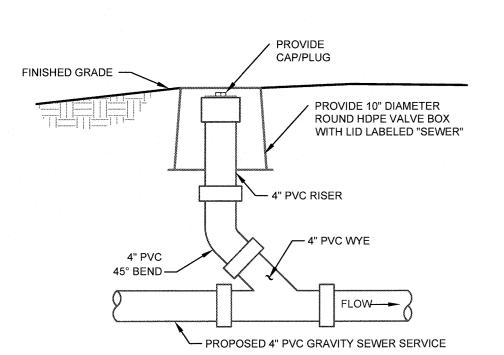


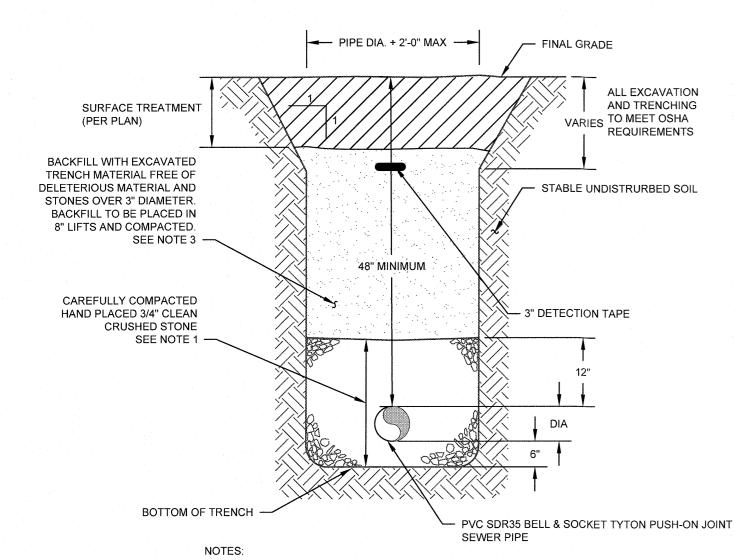

1. ALL FILL BELOW BUILDING AND PAVEMENT TO BE COMPACTED TO 95% MAXIMUM DRY DENSITY AS DETERMINED BY MODIFIED PROCTOR TEST.


2. ALL SEWER MAINS SHALL BE 8" OR 10" SDR 35 PVC. ALL SEWER HEADERS SHALL BE 6" SDR 35 AND ALL SEWER LATERAL TO BE 4" SDR 35 PVC.

3. ALL FILL BELOW BUILDINGS, PAVEMENT AREAS, SIDEWALKS, CURBS, ETC; SHALL BE WITH R.O.B. GRAVEL (NYSDOT SPEC) FOR THE FULL DEPTH THE EXCAVATION. BACKFILL SHALL BE PLACED IN 8" MAXIMUM LIFTS AND COMPACTED TO 95% OF MAXIMUM DRY DENSITY AS DETERMINED BY MODIFIED PROCTOR TEST.

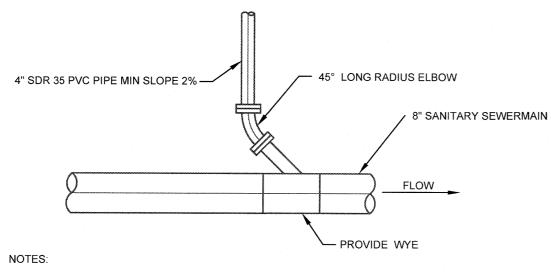

1. A SEWER CLEANOUT IS REQUIRED EVERY 75' OR LESS ALONG THE SERVICE.


SEWER SERVICE CONNECTION

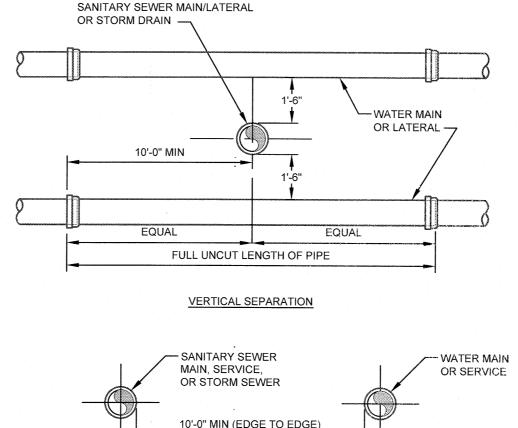

10'-0" MIN (EDGE TO EDGE) HORIZONTAL SEPARATION

NO DEVIATION IN THE SEPARATION REQUIREMENTS WILL BE PERMITTED WITHOUT APPROVAL OF THE ORANGE COUNTY DEPARTMENT OF HEALTH.

WATER/SEWER SEPARATION REQUIREMENTS

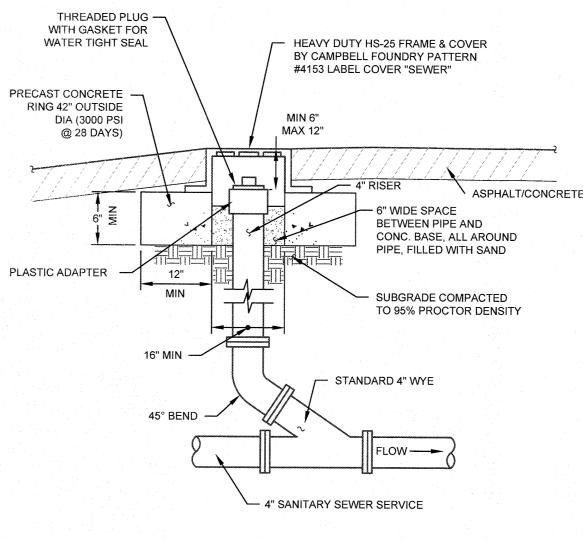

ALL PIPING TO BE PVC SDR 35.

TYPICAL CLEANOUT IN PAVED AREA

GENERAL UTILITY NOTES

SEWER SYSTEM NOTES

2. IF GROUNDWATER IS ENCOUNTERED DURING TRENCH EXCAVATION,

INSTALLATION. ALL DE-WATERING OPERATIONS SHALL BE DONE AT

MAIN PRIOR TO COMMENCEMENT OF CONSTRUCTION AND NOTIFY

DEPARTMENT AT LEAST TWO DAYS PRIOR TO THE COMMENCEMENT

1-800-962-7962 AT LEAST TWO DAYS PRIOR TO THE COMMENCEMENT

WITH TOWN OF NEWBURGH TOWN CODE, INCLUDING BUT NOT LIMITED

TO VACUUM TESTING OF MANHOLES, LOW PRESSURE AIR TEST OF

OF CONSTRUCTION OF SEWERS FOR COMPLETE UTILITY MARKOUT.

6. THE SANITARY SEWER SYSTEM SHALL BE TESTED IN ACCORDANCE

MAINS AND LATERALS, AND VIDEO RECORDING OF ALL MAINS.

THE CONTRACTOR SHALL DE-WATER THE TRENCH PRIOR TO

3. CONTRACTOR TO VERIFY INVERT ELEVATIONS OF EXISTING SEWER

ENGINEER OF ANY DISCREPANCY PRIOR TO COMMENCEMENT.

4. CONTRACTOR SHALL CALL THE TOWN OF NEWBURGH SEWER


5. CONTRACTOR SHALL CALL UNDERGROUND MARKOUT AT

1. ALL GRAVITY SEWER PIPE SHALL BE SDR-35 PVC.

THE CONTRACTOR'S EXPENSE.

OF CONSTRUCTION OF SEWERS.

- 1. THE LOCATION AND SIZE OF EXISTING DRAINAGE FACILITIES ARE FROM SURVEYS, FIELD RECONNAISSANCE OR PLANS OF RECORD. ALL FACILITIES WHICH ARE TO REMAIN OR BE MODIFIED FOR REUSE SHALL BE FIELD VERIFIED AS TO ACTUAL LOCATION, ELEVATIONS, SIZE, TYPE AND CONDITION. ANY DISCREPANCIES BETWEEN ACTUAL FIELD CONDITIONS AND THE PLANS SHALL BE REPORTED TO THE OWNER'S FIELD REPRESENTATIVE FOR RESOLUTION.
- 2. THE CONTRACTOR SHALL REFER TO THE BUILDING MECHANICAL AND PLUMBING PLANS FOR THE EXACT LOCATIONS AND INVERTS OF ALL BUILDING SERVICE CONNECTIONS.
- 3. ALL UTILITY STRUCTURE CASTINGS SHALL BE ADJUST AS NECESSARY TO BE FLUSH WITH PROPOSED FINISHED
- 4. CONTRACTOR TO CALL UFPO AT LEAST 2 DAYS PRIOR TO COMMENCEMENT OF CONSTRUCTION AT 1-800-962-7962 FOR COMPLETE UTILITIES MARKOUT.
- 5. CONTRACTOR TO CONTACT TOWN OF NEWBURGH WATER DEPARTMENT AT (845) 564-7813 AT LEAST 2 DAYS PRIOR TO CONSTRUCTION.
- 6. ALL PIPE INSTALLATION SHALL BE SUBJECT TO INSPECTION BY THE TOWN OF NEWBURGH SEWER & WATER DEPARTMENT. THE CONTRACTOR SHALL BE RESPONSIBLE FOR COORDINATING ALL INSPECTION AS REQUIRED WITH THE TOWN OF NEWBURGH SEWER & WATER DEPARTMENT.

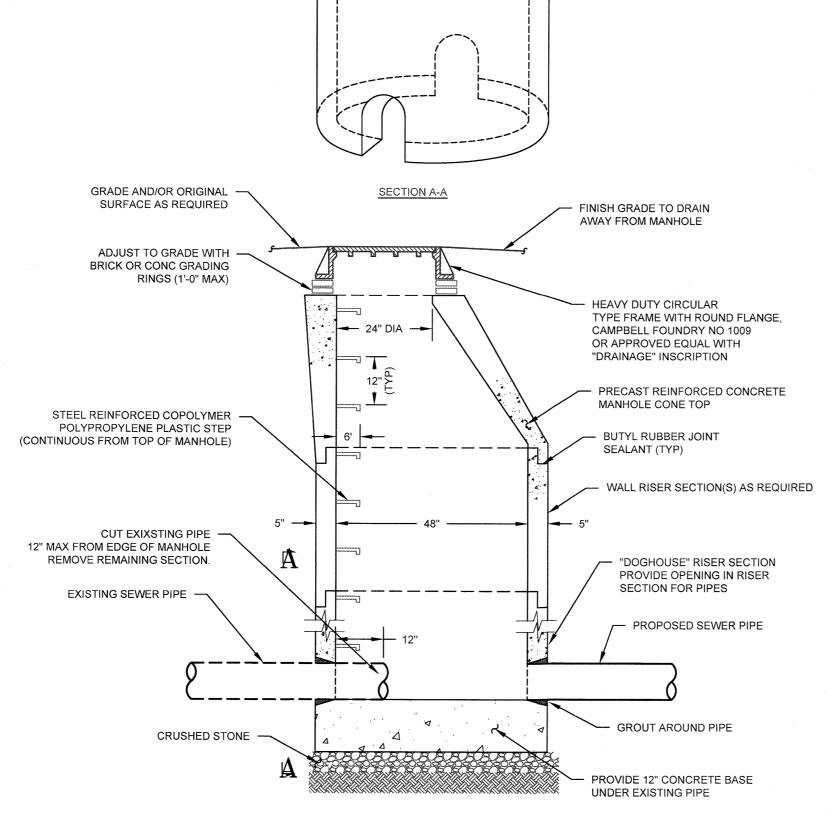


CONCRETE TO HAVE A MINIMUM COMPRESSIVE STRENGTH OF 4000 PSI AT 28 DAYS. REINFORCEMENT TO BE IN CONFORMANCE WITH ASTM A615GRADE 60 AND ASTM

- A185 GRADE 65. 3. CONTRACTOR TO ORDER MANHOLE SECTIONS FROM MANUFACTURER TO MATCH
- REQUIRED ELEVATIONS AND INVERTS PER PLAN 4. MANHOLE CONSTRUCTION TO BE CAPABLE OF WITHSTANDING H-20 LOADINGS.
- PRECAST CONCRETE MANHOLE COMPONENTS BY FORT MILLER OR EQUAL. FOR INSTALLATION; FIRST EXCAVATE AROUND EXISTING SEWER PIPE, THEN POUR THE BASE FOR THE DOGHOUSE MANHOLE, SET THE MANHOLE WALLS OVER THE POURED BASE, GROUT ALL SEAMS THEN CUT THE EXISTING PIPE INSIDE OF THE

DOGHOUSE MANHOLE

DOGHOUSE MANHOLE.

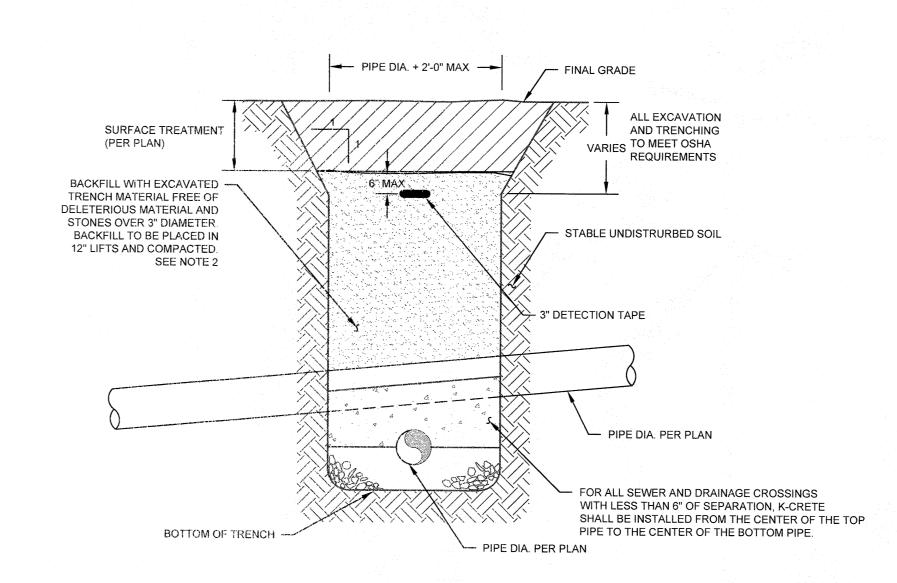


SEWER & DRAINAGE CROSSING WITH LESS THAN 6" SEPARATION BETWEEN PIPES

Dig Safely. New York before you dig


No.	DATE	DESCRIPTION	
0	09/17/19	INITIAL SUBMISSION	
1	04/12/21	REVISED PER COMMENT LETTERS	
2	09/21/21	REVISED PER PLANNING BOARD COMMENTS	
3	02/03/22	REVISED PER PLANNING BOARD COMMENTS	
4	04/07/22	REVISED FOR WETLAND MITIGATION AREA	
	,		
·····			ĺ
			ĺ
		The state of the s	
			İ
***************************************	-		

AND THE PART AND ADDRESS OF THE PARTY OF THE			
DRAWING STATUS	ISSUE DATE: 04/07/22		
THIS SHEET IS PART OF THE PLAN SET ISSUED FOR	SHEET NUMBER		
CONCEPT APPROVAL	N/A	OF	N/A
☑ PLANNING BOARD APPROVAL	9	OF	14
OCDOH REALTY SUBDIVISION APPROVAL	N/A	OF	N/A
OCDOH WATERMAIN EXTENSION APPROVAL	N/A	OF	N/A
☐NYSDEC APPROVAL	N/A	OF	N/A
NYSDOT APPROVAL	N/A	OF	N/A
OTHER	N/A	OF	N/A
☐FOR BID	N/A	OF	N/A
☐ FOR CONSTRUCTION	N/A	OF	N/A
THIS PLAN SET HAS BEEN ISSUED SPECIFICALLY FOR THE APPROVAL OR ACTION NOTED ABOVE AND SHALL NOT BE USED FOR ANY OTHER PURPOSE. THIS SHEET SHALL BE CONSIDERED INVALID UNLESS			

COMPANIED BY ALL SHEETS OF THE DENOTED PLAN SET(S).

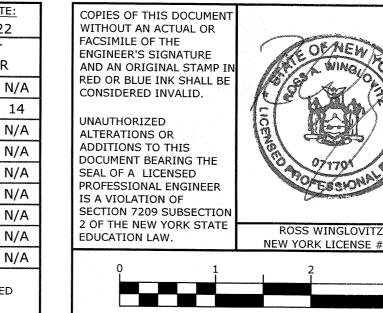

ORIGINAL SCALE IN INCHES



& SURVEYING
ROPERTIES


Achieving Successful Results
with Innovative Designs Ph: (845) 457-7727 WWW.EP-PC.COM DETAILS MONARCH WOODS SENIOR COMMUNITY MONARCH DRIVE TOWN OF NEWBURGH ORANGE COUNTY, NEW YORK


NGINEERING MONTGOMERY OFFICE

71 CLINTON STREET

MONTGOMERY, NY 12549

as noted C-304 - 04/07/22 103-7-18 & 47-1-46

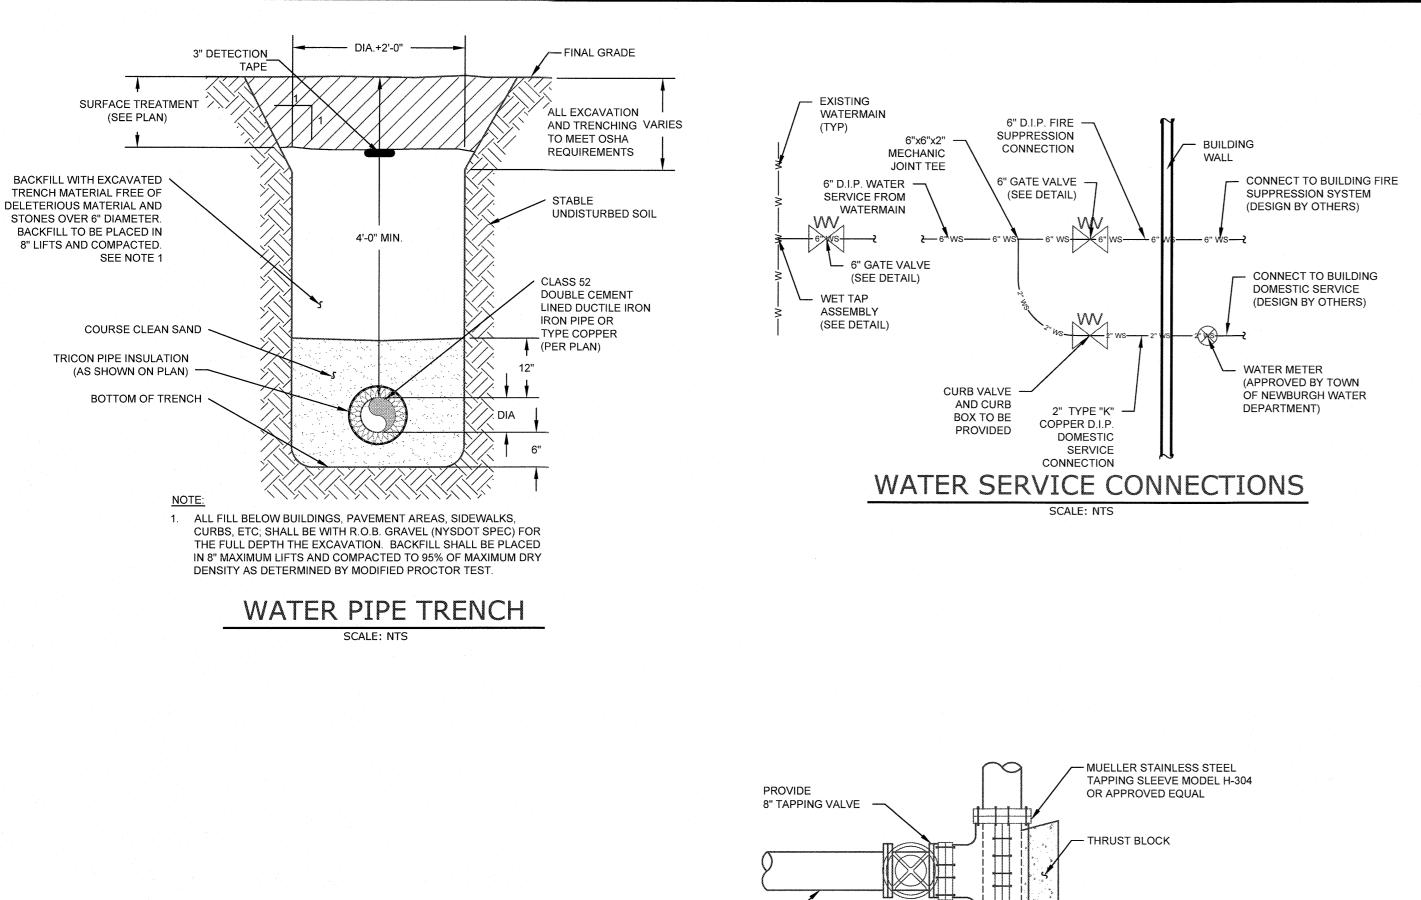

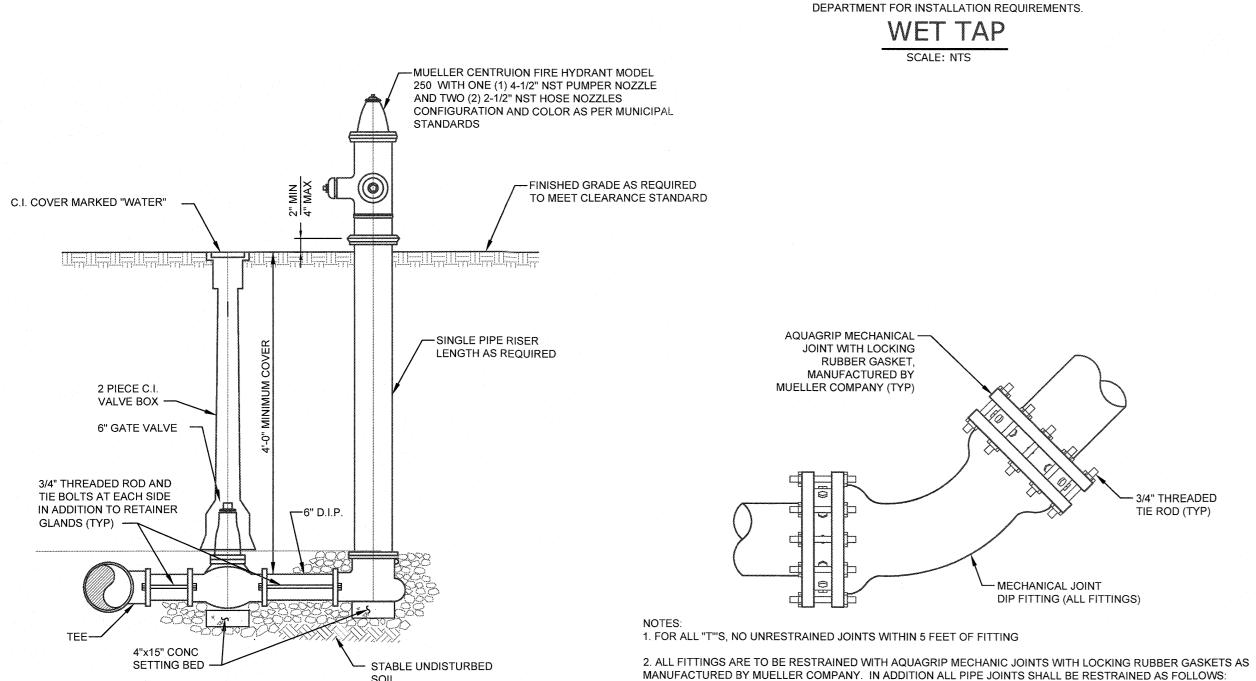

11.25° 10X10 TEE

11.25°

6X10 TEE

6X6 TEE

DEAD END

(BLIND FLANGE)

10X8 TEE

DEAD END

(BLIND FLANGE)

ALL JOINTS WITHIN 11 FEET OF FITTING

ALL 10" BRANCH JOINTS WITHIN 32 FEET OF FITTING

ALL 8" BRANCH JOINTS WITHIN 17 FOOT OF FITTING

ALL 10" BRANCH JOINTS WITHIN 54 FEET OF FITTING

* ASSUMED: 4'-6" COVER, 150 PSI TEST PRESSURE, AND 2.0 TO 1 FACTOR OF SAFETY.

ALL 6" BRANCH JOINTS WITHIN 23 FEET OF FITTING

ALL JOINTS WITH IN 6 FEET OF FITTING ALL JOINTS WITHIN 3 FEET OF FITTING

ALL JOINTS WITHIN 55 FEET OF FITTING

ALL JOINTS WITHIN 8 FEET OF FITTING

ALL JOINTS WITHIN 4 FEET OF FITTING


ALL JOINTS WITHIN 2 FEET OF FITTING

ALL JOINTS WITHIN 32 FEET OF FITTING

- NOTES:

 1. A HYDRANT WITH THE PROPER RISER LENGTH (DEPTH OF BURY) SHALL BE INSTALLED AS REQUIRED TO MEET THE 2" MIN TO 4" MAX CLEARANCE BETWEEN THE CENTER OF THE BREAK AWAY FLANGES AND FINISHED GRADE
- 2. IN AREAS THAT EXPERIENCE SEASONABLY HIGH GROUND WATER LEVELS, THE HYDRANT BARRELL WEEPHOLE MUST REMAIN PLUGGED. IF THE HYDRANT BARRELL WEEPHOLE IS PLUGGED THE HYDRANT MUST BE MARKED ACCORDINGLY TO INDICATE THAT THE BARRELL MUST BE PUMPED DRY AFTER USE TO PREVENT DAMAGE DURING FREEZING TEMPERATURES.
- 3. FIRE HYDRANT TO HAVE ONE SHOP COAT AND ONE FIELD COAT OF PAINT. COLOR SHALL BE PER MUNICIPAL STANDARD.
- 4. ALL MECHANICAL JOINTS AND FITTINGS SHALL UTILIZE EBBA MEGALUG SERIES

HYDRANT ASSEMBLY

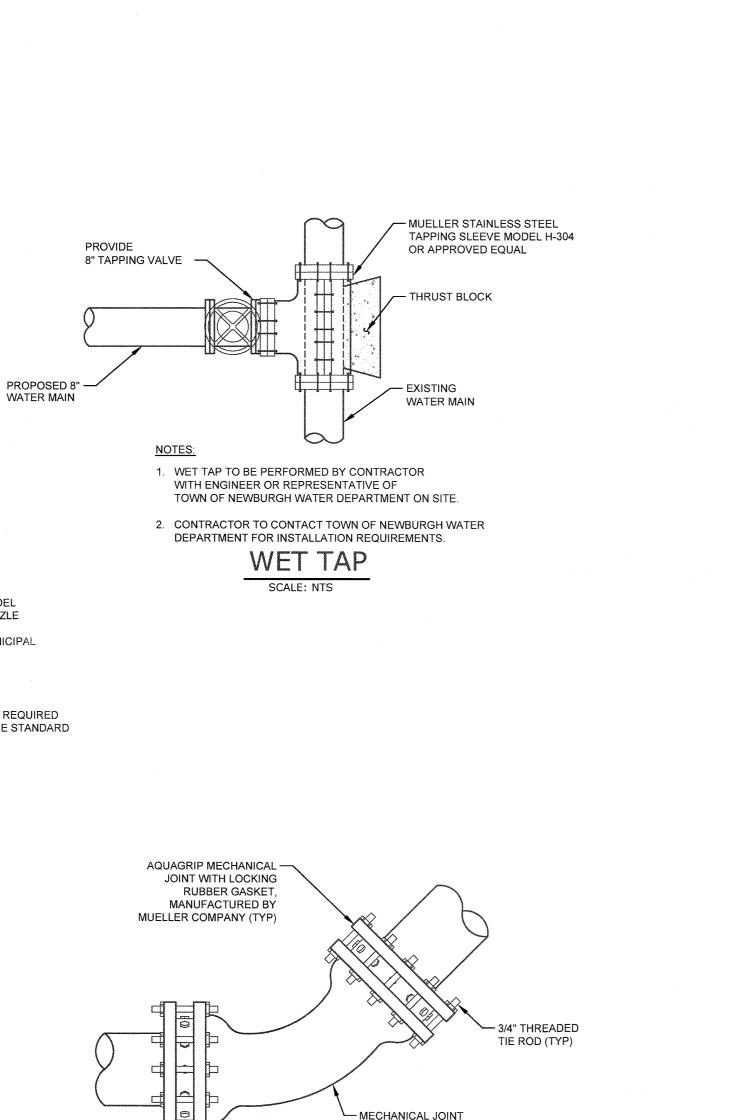

ALL JOINTS WITHIN 9 FEET OF FITTING

ALL JOINTS WITHIN 5 FEET OF FITTING

ALL JOINTS WITHIN 3 FEET OF FITTING

ALL JOINTS WITHIN 46 FEET OF FITTING

8X8 TEE

8x6 TEE


DEAD END

(BLIND FLANGE)


ALL 12" BRANCH JOINTS WITHIN 38 FEET OF FITTING


ALL 8" BRANCH JOINTS WITHIN 23 FEET OF FITTING

ALL 6" BRANCH JOINTS WITHIN 5 FOOT OF FITTING

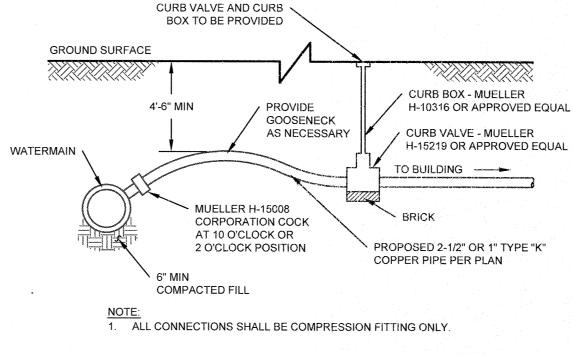

WATER SERVICE CONNECTION

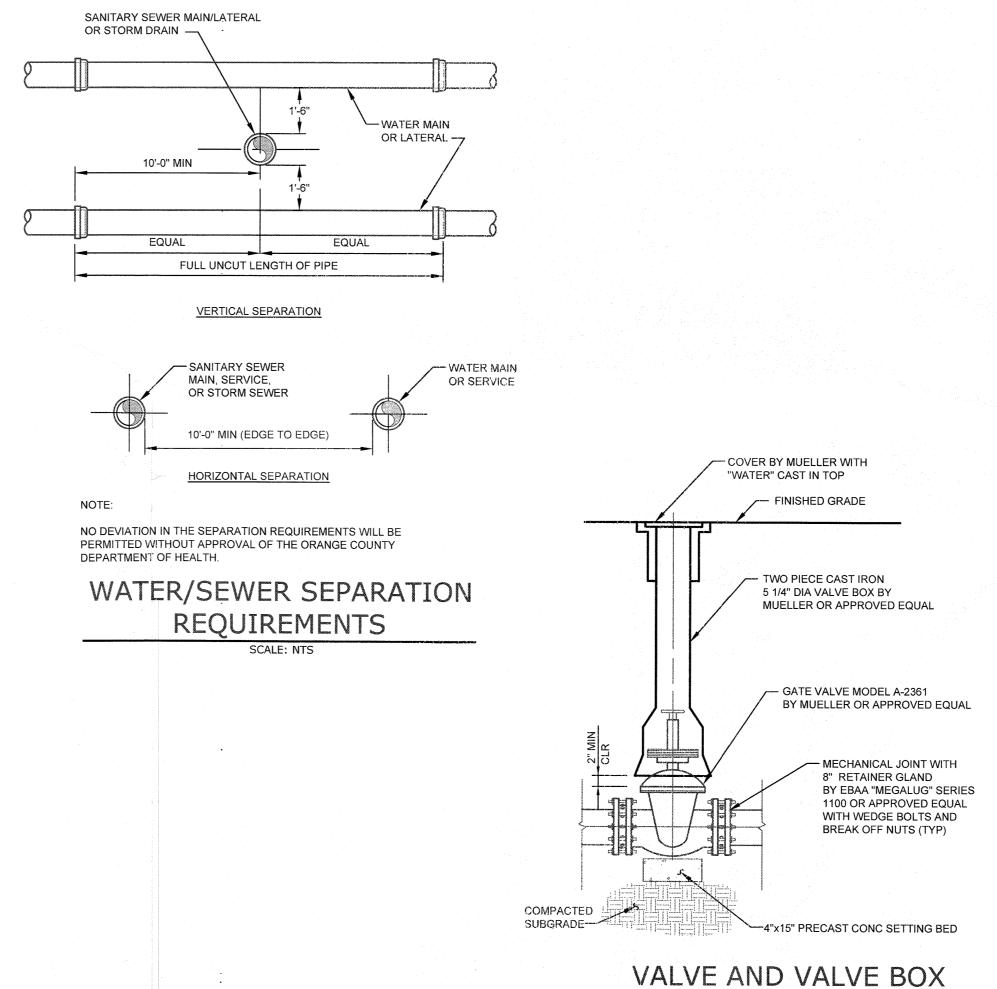

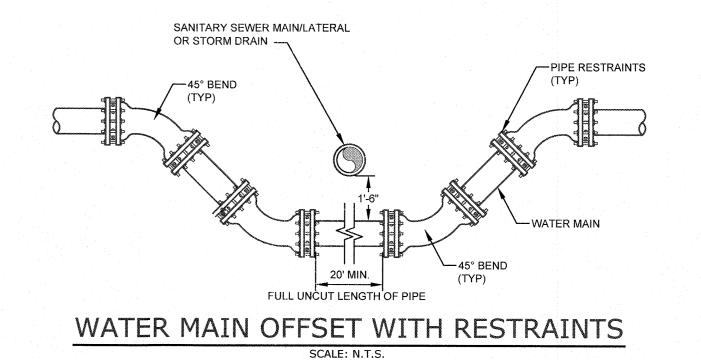

WATER SYSTEM NOTES

- 1. CONTRACTOR SHALL VERIFY THE LOCATION AND ELEVATION OF EXISTING WATER AND SEWER UTILITIES PRIOR TO THE COMMENCEMENT OF CONSTRUCTION.
- 2. CONTRACTOR TO CALL UNDERGROUND MARK-OUT AT LEAST 2 DAYS PRIOR TO COMMENCEMENT OF CONSTRUCTION AT 1-800-962-7962 FOR COMPLETE UTILITIES MARKOUT.
- 3. CONTRACTOR TO CONTACT TOWN OF NEWBURGH WATER DEPARTMENT AT (845) 564-7813 AT LEAST 2 DAYS PRIOR TO CONSTRUCTION.
- 4. WATER MAIN 4" OR LARGER TO BE CLASS 52 BITUMINOUS COATED DOUBLE CEMENT LINED DUCTILE IRON PIPE.
- 5. CONTRACTOR TO NOTIFY ENGINEER IMMEDIATELY OF ANY DEVIATION FROM HORIZONTAL OR VERTICAL ALIGNMENTS WITH REGARDS TO EXISTING UTILITIES BEFORE PROCEEDING.
- 6. A CERTIFIED AS BUILT MAP OF THE WATER SYSTEM IMPROVEMENTS SHALL BE PROVIDED TO THE TOWN OF NEWBURGH WATER DEPARTMENT BY A LICENSED DESIGN PROFESSIONAL.
- 7. ALL APARTMENT UNITS AND THE CLUBHOUSE ARE TO BE INDIVIDUALLY METERED IN

ACCORDANCE WITH THE TOWN OF NEWBURGH REQUIREMENTS.


CONTAIN NO MORE THAN 0.25% LEAD BY WEIGHT.

- 8. ALL PIPE, FIXTURES AND FITTINGS MUST COMPLY WITH THE FEDERAL "SAFE DRINKING WATER ACT", SECTION 1417 WHICH REQUIRES ALL SURFACES IN CONTACT WITH POTABLE WATER
- 9. THE TOWN OF NEWBURGH COMMISSIONER OF PUBLIC WORKS OR HIS DESIGNATED
- REPRESENTATIVE MUST BE INFORMED OF ANY HYDROSTATIC OR BACTERIOLOGICAL TESTING TO PERMIT THE TESTING TO BE WITNESSED.
- 10. THE TOWN OF NEWBURGH COMMISSIONER OR PUBLIC WORKS OR HIS DESIGNATED REPRESENTATIVE MUST ACCEPT HYDROSTATIC AND BACTERIOLOGICAL TEST RESULTS AS

No	DATE	DESCRIPTION	
0	09/17/19	INITIAL SUBMISSION	
1	04/12/21	REVISED PER COMMENT LETTERS	
2	09/21/21	REVISED PER PLANNING BOARD COMMENTS	
3	02/03/22	REVISED PER PLANNING BOARD COMMENTS	
4	04/07/22	REVISED FOR WETLAND MITIGATION AREA	
			1
		The state of the s	
		The state of the s	ĺ
		A STATE OF THE STA	
			1
L			
<u></u>			
L			
<u> </u>			
			i

DRAWING STATUS		JE D	
	04/07/22		
THIS SHEET IS PART OF THE PLAN SET ISSUED FOR	SHEET NUMBER		
☐ CONCEPT APPROVAL	N/A	OF	N/A
PLANNING BOARD APPROVAL	10	OF	14
OCDOH REALTY SUBDIVISION APPROVAL	N/A	OF	N/A
OCDOH WATERMAIN EXTENSION APPROVAL	N/A	OF	N/A
☐NYSDEC APPROVAL	N/A	OF	N/A
NYSDOT APPROVAL	N/A	OF	N/A
OTHER	N/A	OF	N/A
☐FOR BID	N/A	OF	N/A
☐ FOR CONSTRUCTION	N/A	OF	N/A
THIS PLAN SET HAS BEEN ISSUED SPECIFICAL APPROVAL OR ACTION NOTED ABOVE AND SHAFOR ANY OTHER PURPOSE. THIS SHEET SHALL BE CONSIDERED INVALID	ALL NOT		SED

ACCOMPANIED BY ALL SHEETS OF THE DENOTED PLAN SET(S).

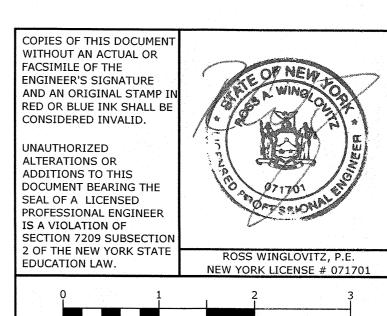

ORIGINAL SCALE IN INCHES

DETAILS MONARCH WOODS SENIOR COMMUNITY MONARCH DRIVE TOWN OF NEWBURGH ORANGE COUNTY, NEW YORK

Achieving Successful Results with Innovative Designs

AS NOTED C-3 4 - 04/07/22 103-7-18 & 47-1-46


MONTGOMERY OFFICE


MONTGOMERY, NY 12549

71 CLINTON STREET

Ph: (845) 457-7727

WWW.EP-PC.COM

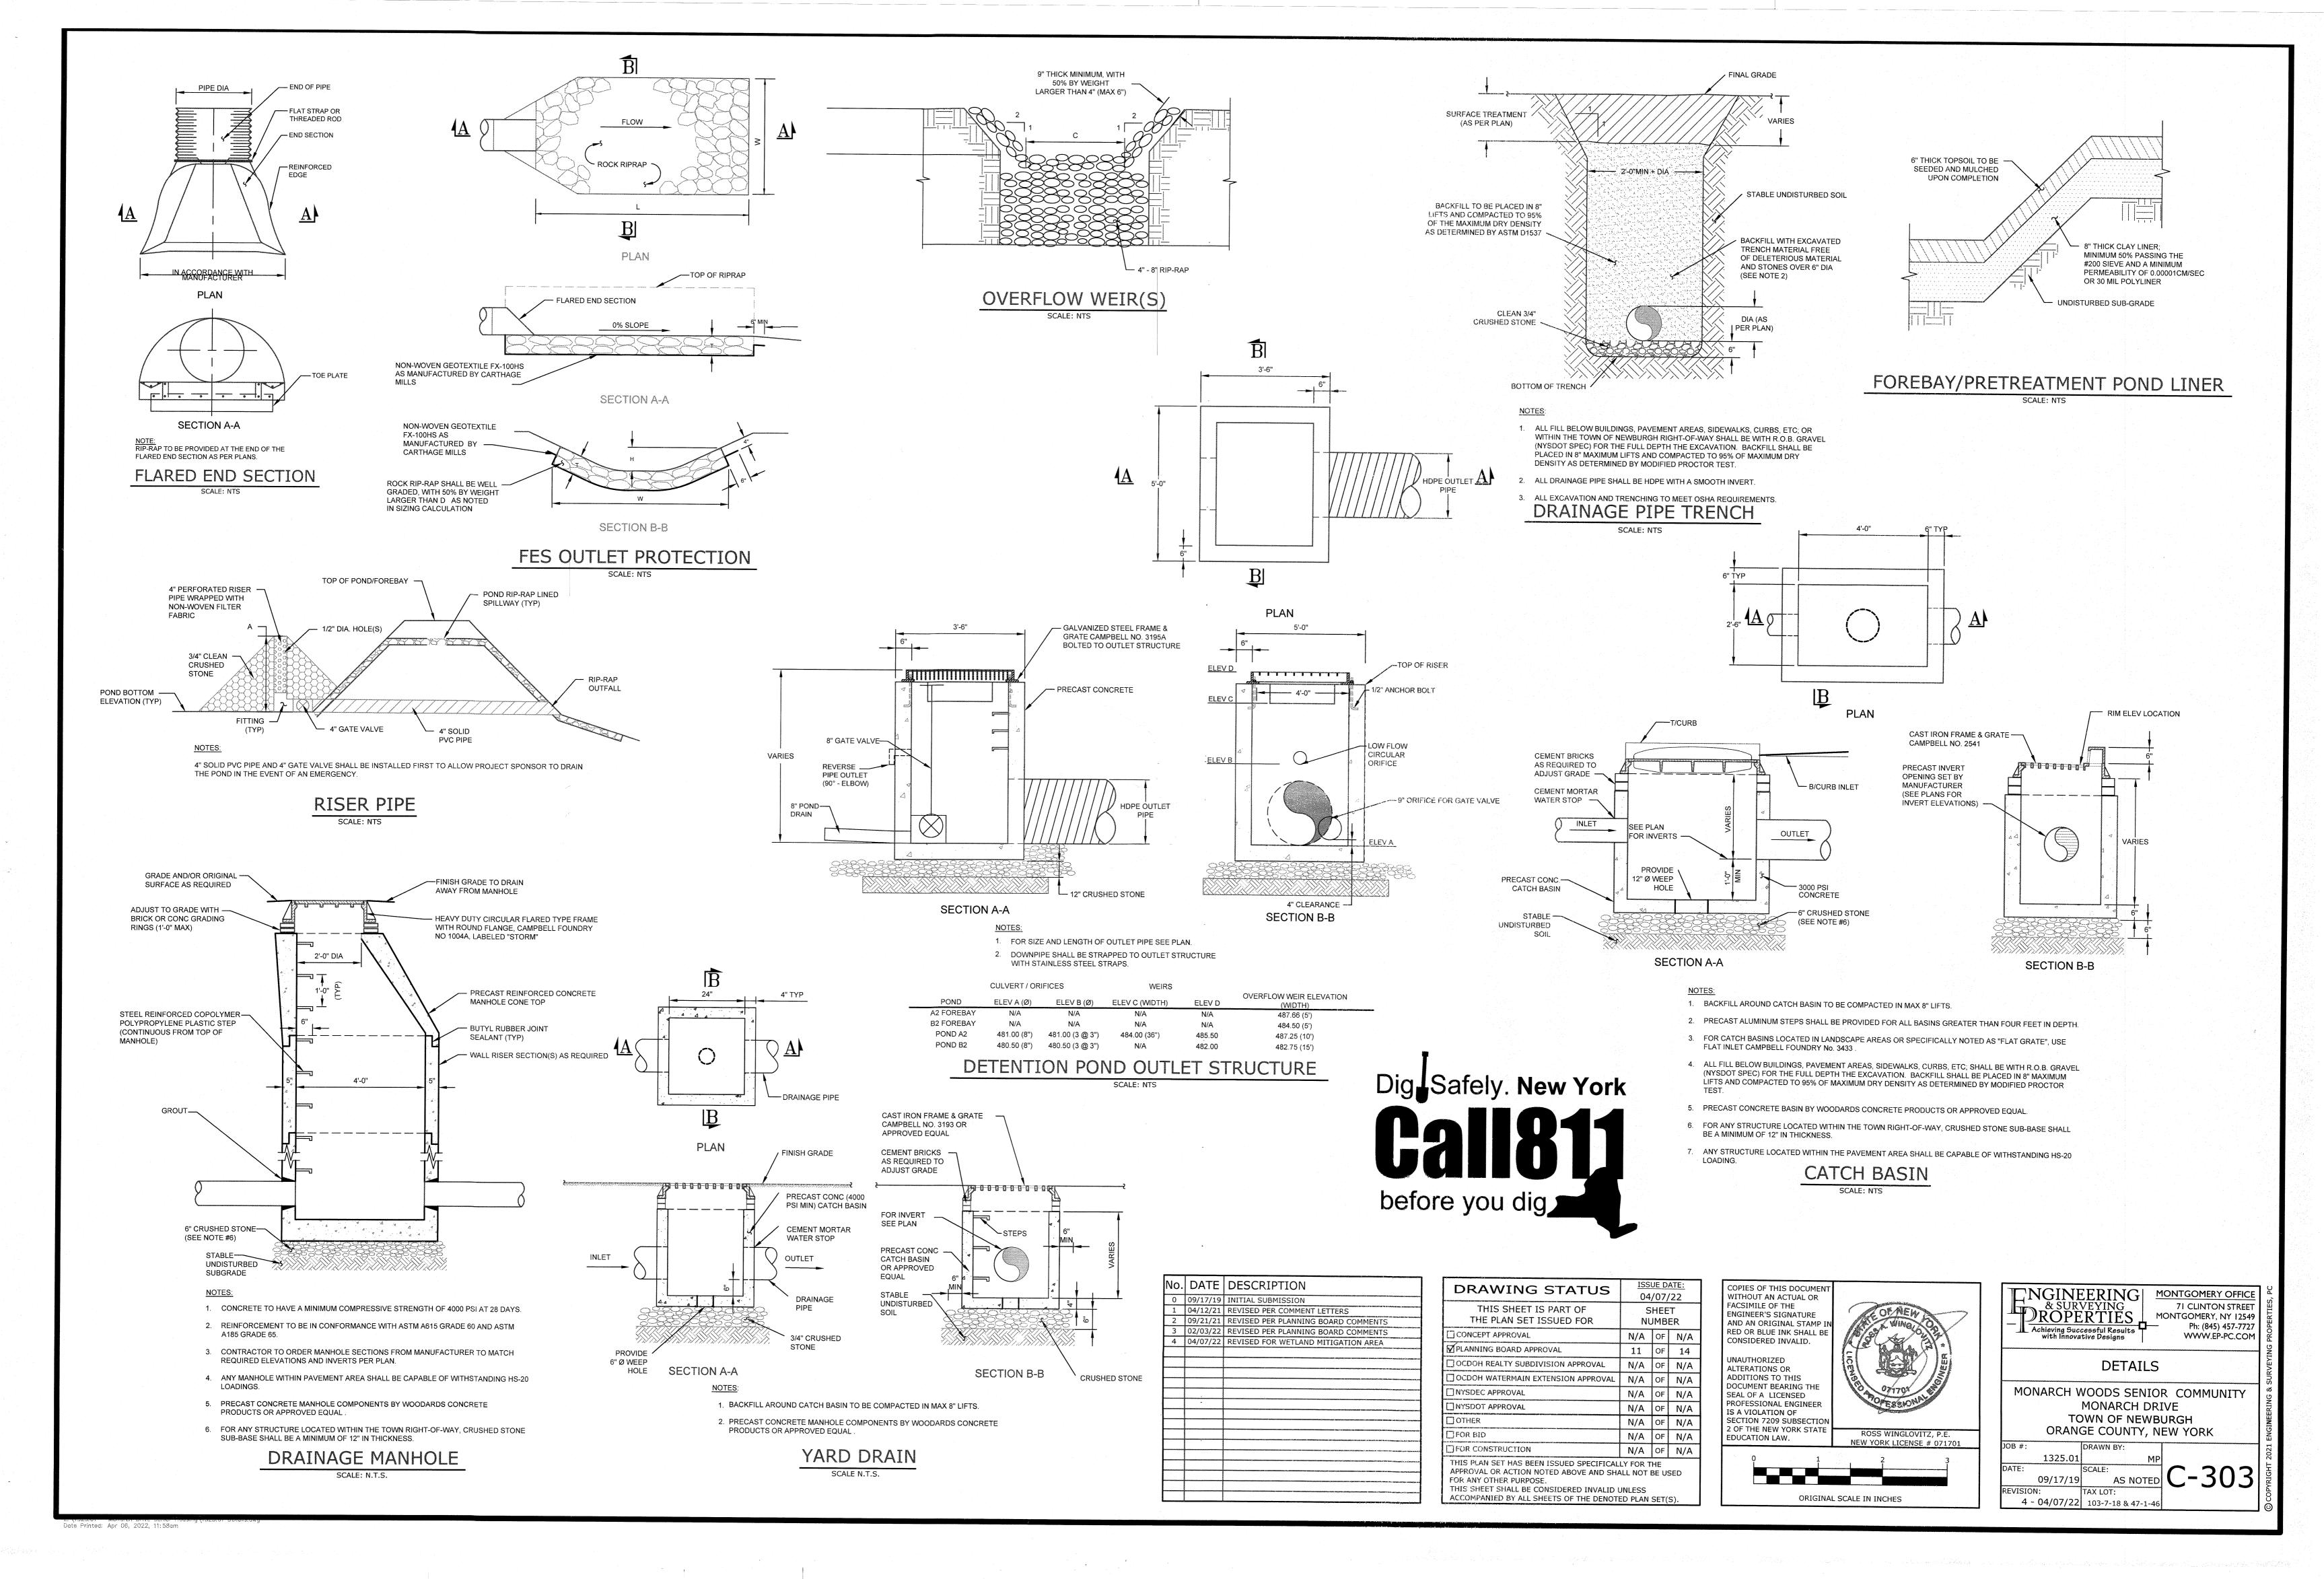


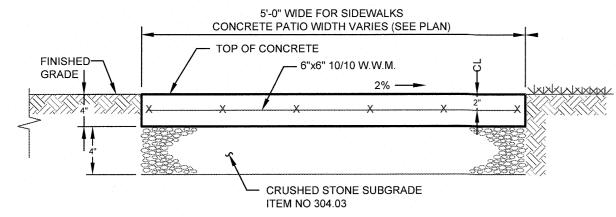


NOTES:


- 1. CURB EXPANSION JOINTS OF 1/4" PREFORMED BITUMINOUS COATED CELLULOSE OR SIMILAR
- 2. SIDEWALK EXPANSION JOINTS SHALL BE SPACED AT 20' INTERVALS AND SHALL BE 4" DEEP, EDGED WITH 1/4" RADIUS.
- 3. ALL CONCRETE FOR SIDEWALKS SHALL BE 4000 PSI AT 28 DAYS WITH TRANSVERSE BROOM FINISH AND CROSS SLOPE.
- 4. SIDEWALKS GREATER THAN 8% IN GRADE SHALL BE STEPPED IN ACCORDANCE WITH THE NEW YORK STATE BUILDING CODE REQUIREMENTS.

SIDEWALK/CONCRETE PATIO DETAIL SCALE: N.T.S.

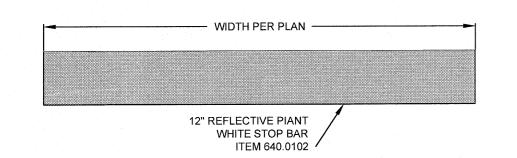

STOP BAR

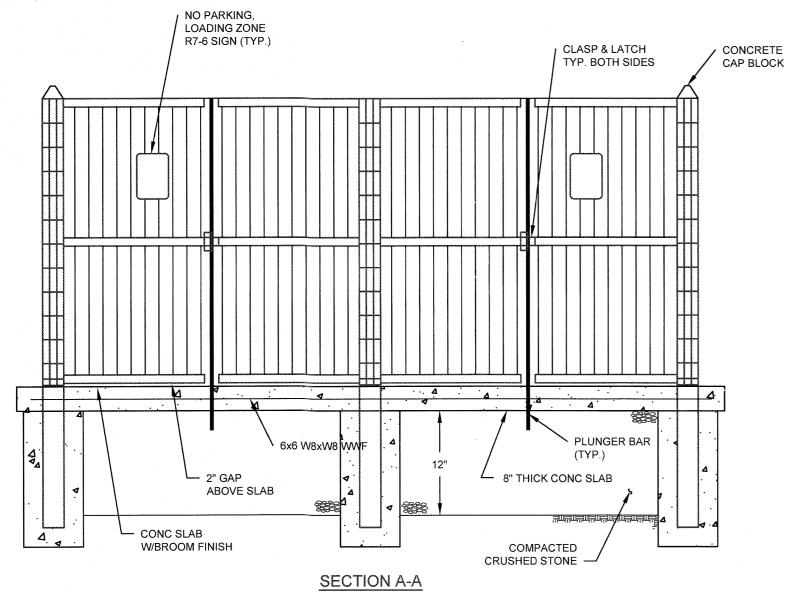


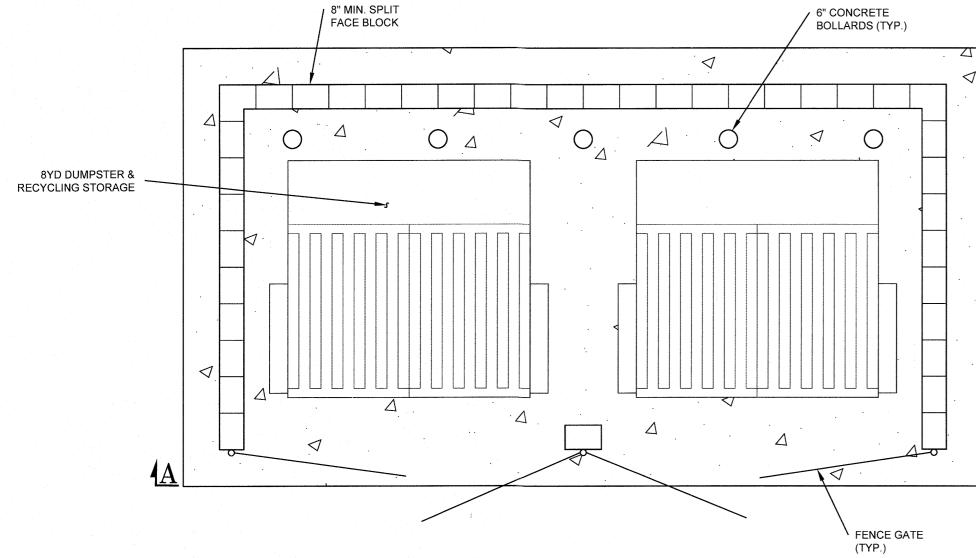

ALL CONCRETE SHALL BE 4000 PSI AT 28 DAYS.


NOTES:

2. HARDWARE CLOTH (GALVANIZED WIRE MESH WITH \$\frac{1}{2}\) INCH SQUARE WEAVE) SHALL BE INSTALLED FROM THE GROUND TO 3 FEET UP THE SIDES OF ALL FIXED FENCES AROUND THE DUMPSTER ENCLOSURES AND DOG RUNS. ALTERNATIVELY THE FENCING CAN BE CONSTRUCTED TO HAVE LESS THAN A 1 INCH GAP.

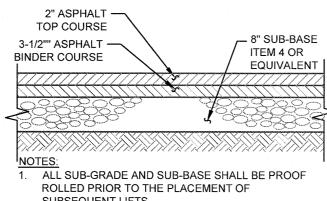

SUBSEQUENT LIFTS. 2. MATERIAL THICKNESS SPECIFIED IS "AFTER"

ON-SITE PAVEMENT SECTION SCALE: NTS

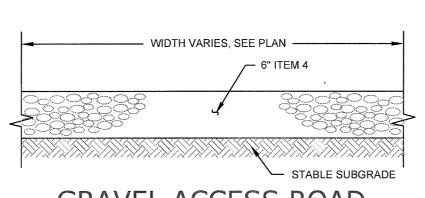



FINISHED . SURFACE AS PER PLAN SEE PAVEMENT SECTION 4,000 PSI CLASS A CONCRETE

> NOTES:
>
> 1. CURB SHALL BE CAST IN PLACE AT ATMOSPHERIC TEMPERATURES ABOVE 40° FAHRENHEIT.

- 2. EXPANSION JOINTS OF 1/4" CELLULOSE OR SIMILAR MATERIAL SHALL BE PLACE AT 10 (TEN) FOOT INTERVALS.
- 3. TEMPORARY FORM SUPPORTS SHALL BE REMOVED DURING

SCALE: N.T.S.

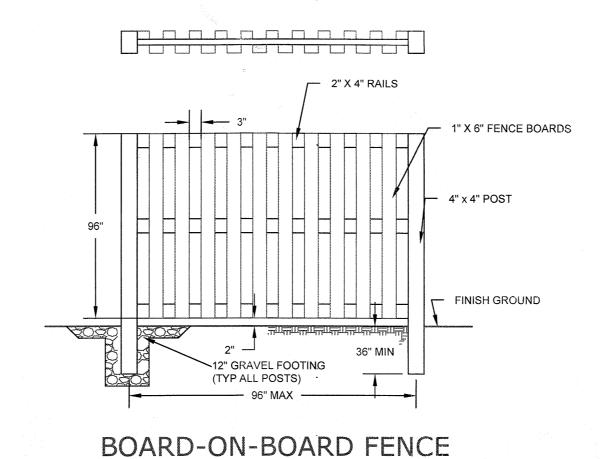

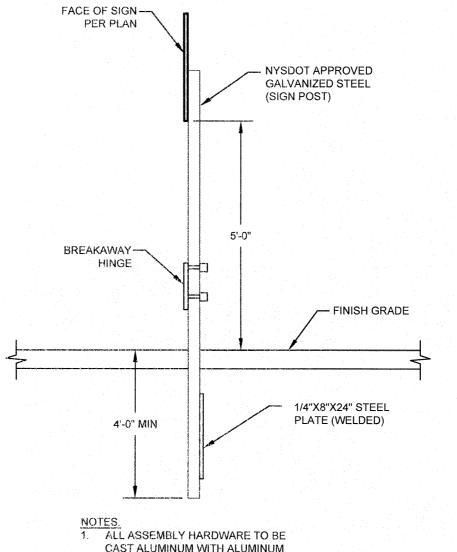


M.U.T.C.D. SIZE OF TYPE OF SIGN TEXT DESCRIPTION SIGN MOUNT No. NO PARKING ANY TIME WHITE BACKGROUND P1-1C GR MTD 12" x 18" RED LETTERING RED BACKGROUND STOP R1-1C 36" x 36" GR MTD WHITE LEGEND RESERVED PARKING BLUE BACKGROUND M12-1 18" x 24" GR MTD BLACK SYMBOL WHITE LETTERING

SIGN SCHEDULE

NOTES:

1. ALL ASSEMBLY HARDWARE TO BE CAST ALUMINUM WITH ALUMINUM

ALL SIGNS SHALL CONFORM TO ALL NYSDOT AND MUTCD REQUIREMENTS.

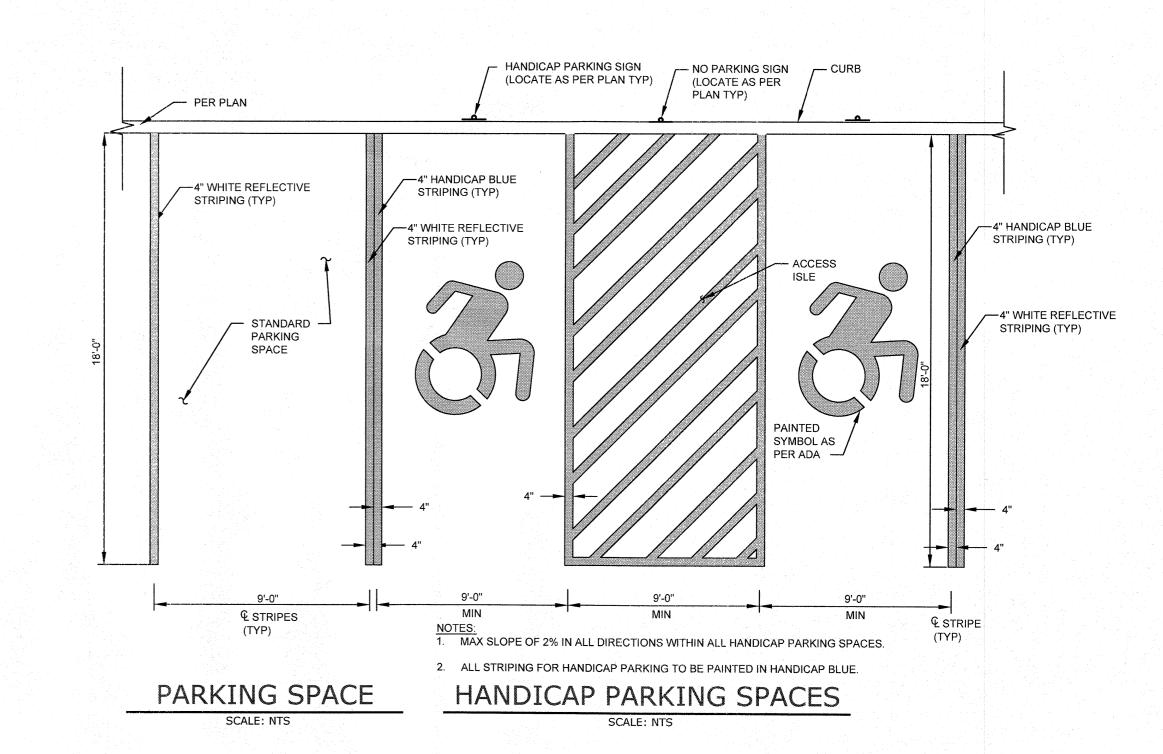

Dig Safely. New York before you dig_

No.	DATE	DESCRIPTION
0	09/17/19	INITIAL SUBMISSION
1	04/12/21	REVISED PER COMMENT LETTERS
2	09/21/21	REVISED PER PLANNING BOARD COMMENTS
3	02/03/22	REVISED PER PLANNING BOARD COMMENTS
4	04/07/22	REVISED FOR WETLAND MITIGATION AREA

		The state of the s
	ļ	
·		
***************************************	ļ	
		
		
	8	

ISSUE DATE: 04/07/22			
SHEET NUMBER			
N/A	OF	N/A	
12	OF	14	
N/A	OF	N/A	
N/A	OF	: N/A	
	04 SNU N/A 12 N/A N/A N/A N/A	04/07/ SHEE NUMB! N/A OF 12 OF N/A OF N/A OF N/A OF N/A OF N/A OF N/A OF	

THIS SHEET SHALL BE CONSIDERED INVALID UNLESS


ACCOMPANIED BY ALL SHEETS OF THE DENOTED PLAN SET(S).


FOR ANY OTHER PURPOSE.

4	COPIES OF THIS DOCUMENT WITHOUT AN ACTUAL OR FACSIMILE OF THE ENGINEER'S SIGNATURE AND AN ORIGINAL STAMP IN RED OR BLUE INK SHALL BE CONSIDERED INVALID. UNAUTHORIZED ALTERATIONS OR ADDITIONS TO THIS DOCUMENT BEARING THE SEAL OF A LICENSED PROFESSIONAL ENGINEER IS A VIOLATION OF SECTION 7209 SUBSECTION 2 OF THE NEW YORK STATE	OF NEW CONTROL OF THE SERVING OF THE
\	EDUCATION LAW.	ROSS WINGLOVITZ, P.E. NEW YORK LICENSE # 071701
1	0 1	2 3

ORIGINAL SCALE IN INCHES

	_							
>			% SURY PROPE	EERING VEYING LRTIES Cessful Results tive Designs		ONTGOMERY 71 CLINTOI ONTGOMERY, Ph: (845) WWW.EP	N STREET NY 12549 457-7727	SURVEYING PROPERTIES, PC
				DETA:	LS			SURVEYIN
······································		MONARCH WOODS SENIOR COMMUNITY MONARCH DRIVE TOWN OF NEWBURGH ORANGE COUNTY, NEW YORK						
		JOB #:	1325.01	DRAWN BY:	MP			- 2021
		DATE:	09/17/19	SCALE: AS NO	TED	C-3	04	YRIGHT
		REVISIO 4		TAX LOT: 103-7-18 & 47				©COPYRIGHT 2021

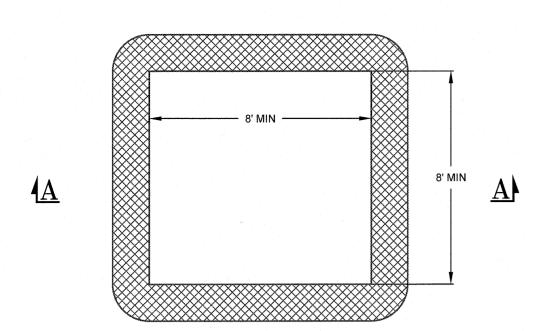

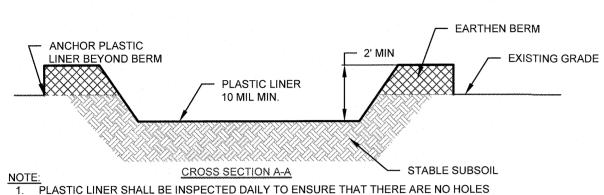


CLEANING OF THE WASHOUT FACILITY. WASHOUT FACILITY SHALL BE LOCATED A MINIMUM OF 100 FEET FROM DRAINAGE SWALES, STORM DRAIN INLETS, WETLANDS, STREAMS OR OTHER SURFACE WATERS.

CLEANED IMMEDIATELY. THE PLASTIC LINER SHALL BE REPLACED WITH EACH

OR TEARS. IF ANY HOLES OF TEARS ARE FOUND THE LINER SHALL BE REPLACED AND

- 3. ACCUMULATED HARDENED MATERIAL SHALL BE REMOVED WHEN 75% OF THE STORAGE CAPACITY OF THE STRUCTURE IS FILLED. ANY EXCESS WASH WATER SHALL BE PUMPED INTO A CONTAINMENT VESSEL AND PROPERLY DISPOSED OF.
- 4. DISPOSE OF THE HARDENED MATERIAL OFF-SITE IN A CONSTRUCTION/DEMOLITION LANDFILL.

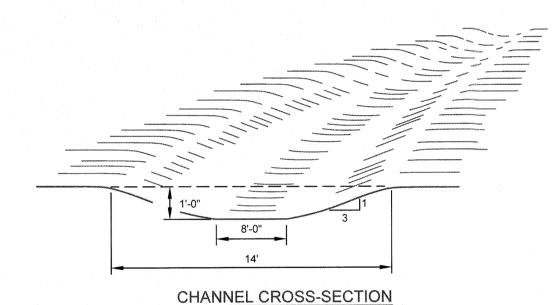


CONSTRUCTION SPECIFICATIONS:

1. ALL TREES, BRUSH, STUMPS, OBSTRUCTIONS AND OTHER OBJECTIONABLE SHALL BE REMOVED AND DISPOSED OF SO AS NOT TO INTERFERE WITH THE PROPER FUNCTIONING OF THE WATERWAY


- 2. THE WATERWAY SHALL BE EXCAVATED OR SHAPED TO LINE, GRADE AND CROSS SECTION AS REQUIRED TO MEET THE CRITERIA SPECIFIED HEREIN, AND BE FREE OF BANK PROJECTIONS OR OTHER IRREGULARITIES WHICH WILL IMPEDE NORMAL FLOW.
- 3. ALL EARTH REMOVED AND NOT NEEDED IN CONSTRUCTION SHALL BE SPREAD OR DISPOSED OF OUTSIDE THE WETLAND SO THAT IT WILL NOT INTERFERE WITH THE FUNCTIONING OF THE WATERWAY.
- 4. STABILIZATION SHALL BE DONE ACCORDING TO THE APPROPRIATE STANDARDS AND SPECIFICATIONS FOR VEGETATIVE PRACTICES. SEEDING AND MULCHING SHALL BE USED FOR ESTABLISHMENT OF THE VEGETATION. VEGETATION PROVIDED SHALL BE REED CANARYGRASS, TALL FESCUE, KENTUCKY

GRASSED SWALE

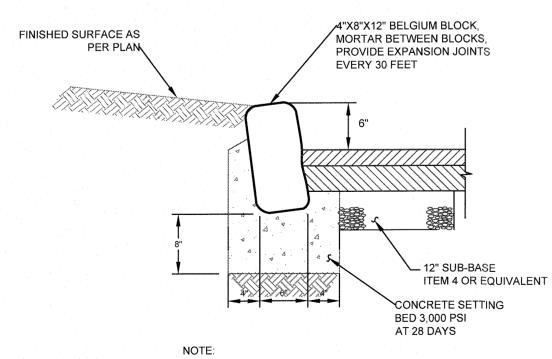

ALL ON-SITE CURBING TO BE BELGIUM BLOCK.

BELGIUM BLOCK CURB

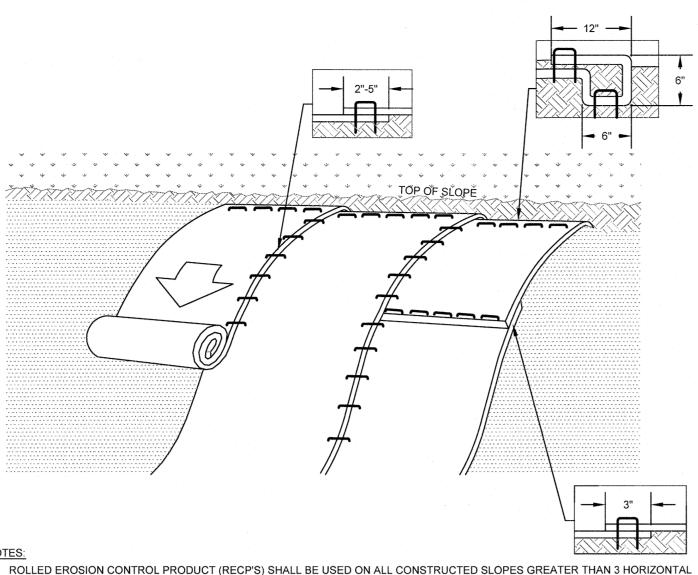


1. ROLLED EROSION CONTROL PRODUCT (RECP'S) SHALL BE USED ON ALL CONSTRUCTED SLOPES GREATER THAN 3 HORIZONTAL

- 2. PREPARATION OF THE SOIL INCLUDING ANY NECESSARY APPLICATION OF LIME, FERTILIZER, AND SEED SHALL BE COMPLETED PRIOR TO INSTALLATION OF ANY RECP'S.
- INSTALL RECP NORTH AMERICAN GREEN BIONET S150BN OR APPROVED EQUAL. BEGIN AT THE TOP OF THE SLOPE BY ANCHORING THE RECP'S IN A 6" DEEP BY 6" WIDE TRENCH WITH APPROXIMATELY 12" OF RECP'S EXTENDED BEYOND THE UP-SLOPE PORTION OF THE TRENCH. ANCHOR THE RECP'S WITH A ROW OF STAPLES/STAKES APPROXIAMTELY 12" APART IN THE BOTTON OF THE TRENCH, BACKFILL AND COMPACT THE TRENCH AFTER STAPLING, APPLY SEED TO COMPACTED SOIL AND FOLD REMAINING 12" PORTION OF RECP'S BACK OVER SEED AND COMPACTED SOIL. SECURE RECP'S OVER COMPACTED SOIL WITH A ROW OF STAPLES/STAKES SPACE APPROXIMATELY 12" APART ACROSS THE WIDTH OF THE RECP'S.
- 4. ROLL THE RECP'S DOWN THE SLOPE OR HORZONTALLY ACROSS THE SLOPE. ALL RECP'S MUST BE SECURLY FASTENED TO SOIL SURFACE BY PLACING STAPLES/STAKES IN APPROPRIATE LOCATIONS AS SHOWN IN THE PRODUCT'S STAPLE PATTERN
- 5. THE EDGES OF PARALLEL RECP'S MUST BE STAPLED WITH APPROXIMATELY 2" TO 5" OVERLAP DEPENDING ON RECP'S TYPE.
- 6. CONSECUTIVE RECP'S SPLICED DOWN THE SLOPE MUST BE PLACED END OVER END (SHINGLE STYLE) WITH AN APPROXIAMATE 3" OVERLAP. STAPLE THROUGH OVERLAPPED AREA, APPROXIMATELY 12" APART ACROSS THE ENTIRE RECP'S WIDTH.

SLOPE STABILIZATION (ROLLED EROSION CONTROL PRODUCT)


BELGIUM

BLOCK CURB-

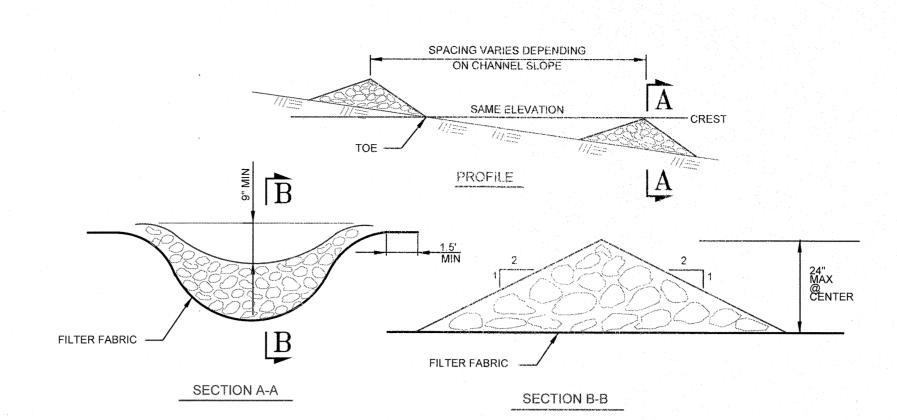


CONSTRUCTION SPECIFICATIONS


- STONE SHALL BE MAXIMUM SIZE OF 12" WITH 50 TO 100 PERCENT BY WEIGHT LARGER THAN 6" AND 0 TO 10 PERCENT SMALLER THAN 1/2".
- 2. FILTER FABRIC SHALL BE POLY-FILTER X CLOTH AS MANUFACTURED BY CARTHAGE MILLS
- 3. STONE WILL BE PLACED ON A FILTER FABRIC FOUNDATION AT LOCATIONS SHOWN ON THE PLAN.
- 4. SET SPACING OF CHECK DAMS TO ASSURE THAT THE ELEVATIONS OF THE CREST OF THE DOWNSTREAM DAM IS AT THE SAME ELEVATION AS THE TOE OF THE UPSTREAM DAM.
- 5. EXTEND THE STONE A MINIMUM OF 1.5 FEET BEYOND THE DITCH BANKS TO PREVENT CUTTING AROUND THE DAM.
- 6. PROTECT THE CHANNEL DOWNSTREAM OF THE LOWEST CHECK DAM FROM SCOUR AND EROSION WITH STONE OR LINER AS APPROPRIATE.
- 7. ENSURE THAT CHANNEL APPURTENANCES SUCH AS CULVERT ENTRANCES BELOW CHECK DAMS



SEQUENCE OF CONSTRUCTION ACTIVTY

- 1. PRE-CONSTRUCTION: NOTIFY APPROPRIATE MUNICIPAL AND UTILITY OFFICIALS 3 DAYS PRIOR TO START OF CONSTRUCTION.
- 2. CONSTRUCTION STAGING: STAKE OUT LIMIT OF DISTURBANCE. INSTALL SILT FENCE DOWN HILL OF PROPOSED CONSTRUCTION, INSTALL ORANGE CONSTRUCTION FENCING ALONG THE LIMITS OF DISTURBANCE INSTALL STABILIZED CONSTRUCTION ENTRANCE AND STABLIZE CONSTRUCTION ROAD(S) INSTALL TEMPORARY SEDIMENT TRAP. INSTALL PERMANENT/TEMPORARY GRASSED SWALES.
- 3. CLEARING AND GRUBBING: REMOVE VEGETATION FROM AREA OF CONSTRUCTION. STRIP TOPSOIL AND STOCKPILE IN AREAS SHOWN ON THE PLAN. INSTALL SEDIMENT BARRIERS AROUND AND ESTABLISH TEMPORARY VEGETATION ON TOPSOIL STOCKPILES:
- 4. ROUGH GRADING: CUT AND FILL SITE TO APPROXIMATE ELEVATIONS SHOWN ON THE PLAN. IMPLEMENT DUST CONTROL MEASURES AS NECESSARY. ESTABLISH PERMANENT STABLIZATION IN AREAS THAT ARE COMPLETE. ESTABLISH TEMPORARY STABLIZATION ON AREAS THAT WILL BE GRADED AGAIN MORE THAN 21 DAYS FROM LAST DISTURBANCE.
- 5. ROAD/BUILDING CONSTRUCTION AND UTILITY INSTALLATION: FINAL GRADING AND CONSTRUCTION OF ROADWAYS. BUILDING EXCAVATION AND CONSTRUCTION. INSTALL UTILITIES. INSTALL DRAINAGE INLET AND OUTLET PROTECTION AS EACH INLET/OUTLET IS CONSTRUCTED. ENSURE ALL EROSION CONTROL MEASURES ARE IN WORKING ORDER.
- 6. FINAL GRADING AND LANDSCAPING: REMOVE TEMPORARY SEDIMENT TRAPS AND INSTALL PERMANENT WATER QUALITY/QUANTITY FACILITIES. COMPLETE FINE GRADING OF SITE. SPREAD TOPSOIL AND PREPARE FOR PERMANENT SEEDING AND PLANTING. ESTABLISH PERMANENT VEGETATION IN ALL REMAINING UNSTABILIZED AREAS. INSTALL ALL SITE LANDSCAPING AND
- 7. POST CONSTRUCTION: UPON STABILIZATION OF THE SITE AND ESTABLISHMENT OF ALL VEGETATION COVER, REMOVE ALL REMAINING TEMPORARY EROSION CONTROL MEASURES SUCH AS SILT FENCE. REMOVE ALL SILT AND DEBRIS FROM THE SITE INCLUDING ROADWAYS, CATCH BASINS AND STORM DRAINS.

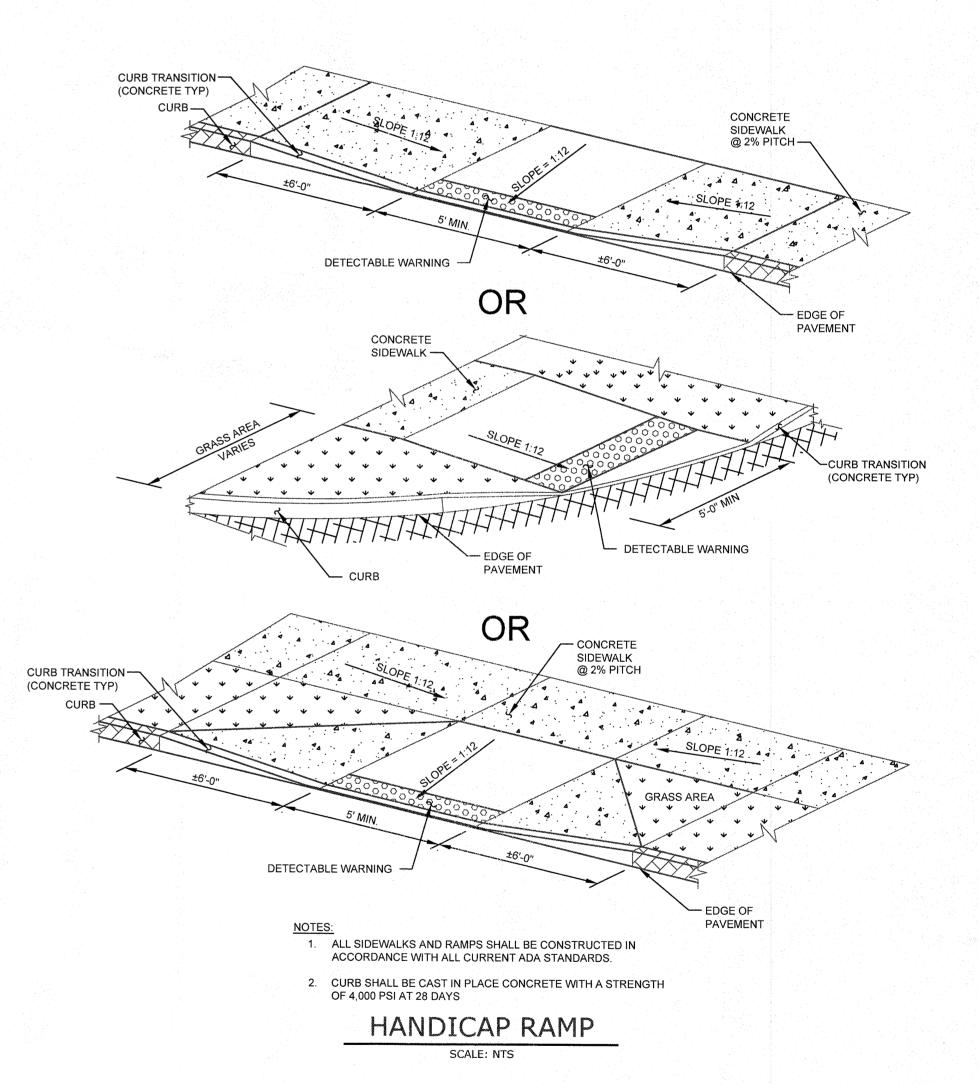

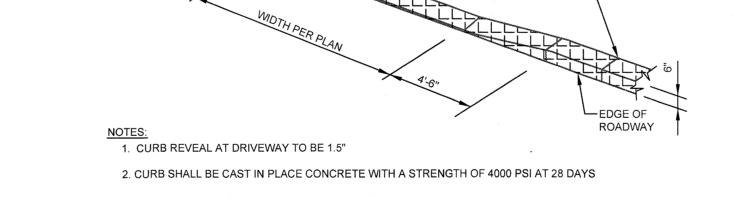

EXPANSION JOINT MATERIAL -

-EXPANSION JOINT MATERIAL

-CURB TRANSITION

ACCESS ROAD CURB DROP WITHOUT SIDEWALK

Dig Safely. New York before you dig_

No.	DATE	DESCRIPTION	1
. 0	09/17/19	INITIAL SUBMISSION	1
1	04/12/21	REVISED PER COMMENT LETTERS	1
2	09/21/21	REVISED PER PLANNING BOARD COMMENTS	1
3	02/03/22	REVISED PER PLANNING BOARD COMMENTS	
4	04/07/22	REVISED FOR WETLAND MITIGATION AREA	1
		7 - 7 - 4 - 4 - 7 - 7 - 7 - 7 - 7 - 7 -	
		A CONTRACTOR OF THE PROPERTY O	
			1
		The second secon	
		A CONTRACTOR OF THE PROPERTY O	1
	-		1
	•		
	-		
A			
		200 A 20 TO A 144 THOUSE TO A	

DRAWING STATUS		UE D/ /07/	
THIS SHEET IS PART OF THE PLAN SET ISSUED FOR	_	HEE JMBI	•
CONCEPT APPROVAL	N/A	OF	N/A
☑PLANNING BOARD APPROVAL	13	OF	14
OCDOH REALTY SUBDIVISION APPROVAL	N/A	OF	N/A
OCDOH WATERMAIN EXTENSION APPROVAL	N/A	OF	N/A
NYSDEC APPROVAL	N/A	OF	N/A
NYSDOT APPROVAL	N/A	OF	N/A
OTHER	N/A	OF	N/A
□FOR BID	N/A	OF	N/A
FOR CONSTRUCTION	N/A	OF	N/A
THIS PLAN SET HAS BEEN ISSUED SPECIFICAL APPROVAL OR ACTION NOTED ABOVE AND SHAFOR ANY OTHER PURPOSE. THIS SHEET SHALL BE CONSIDERED INVALID ACCOMPANIED BY ALL SHEETS OF THE DENOT	ALL NOT	BE US	


COPIES OF THIS DOCUMENT WITHOUT AN ACTUAL OR FACSIMILE OF THE ENGINEER'S SIGNATURE AND AN ORIGINAL STAMP IN RED OR BLUE INK SHALL BE CONSIDERED INVALID. UNAUTHORIZED ALTERATIONS OR ADDITIONS TO THIS DOCUMENT BEARING THE SEAL OF A LICENSED PROFESSIONAL ENGINEER IS A VIOLATION OF	WING COLUMN BE WAS A SELONAL BY WING COLUMN BE WAS A SELONAL BY WING COLUMN BE WAS A SELONAL BY WAS A SELONA
SECTION 7209 SUBSECTION 2 OF THE NEW YORK STATE	ROSS WINGLOVITZ, P.E.
EDUCATION LAW.	NEW YORK LICENSE # 071701
0 1	2 3

ORIGINAL SCALE IN INCHES

	& SURV ROPE	EERING VEYING ERTIES Cessful Results tive Designs		ONTGOMERY OFFICE 71 CLINTON STREET ONTGOMERY, NY 12549 Ph: (845) 457-7727 WWW.EP-PC.COM		
		DETAI	LS			
MONARCH WOODS SENIOR COMMUNITY MONARCH DRIVE TOWN OF NEWBURGH ORANGE COUNTY, NEW YORK						
JOB #:		DRAWN BY:				
5.75	1325.01		MP			
DATE:	09/17/19	SCALE: AS NO	TED	C-305		


4 - 04/07/22 103-7-18 & 47-1-46

Date Printed: Apr 06, 2022, 11:58gm

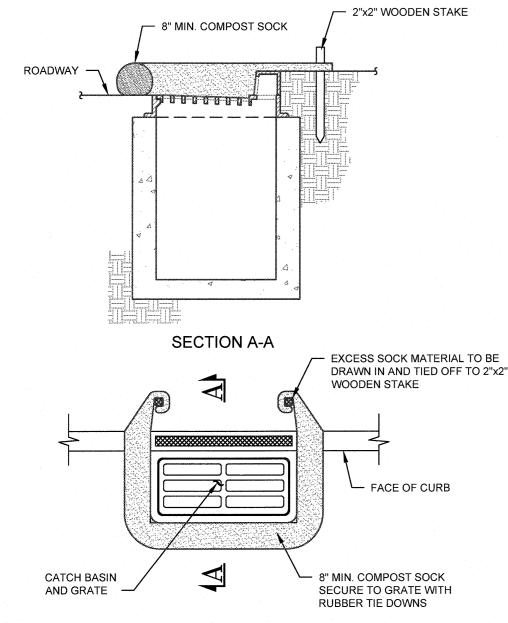

- 1. COMPOST SOCK BY FILTREXX SILTSOXX 8" DIAMETER, OR APPROVED EQUAL
- 2. ALL MATERIAL AND FILTER MEDIA FILL TO MEET MANUFACTURER'S SPECIFICATIONS.
- 3. SEDIMENT SHALL BE REMOVED AND THE COMPOST SOCK REPAIRED OR REPLACED WHEN THE SEDIMENT HAS ACCUMULATED TO 1/2 THE DESIGN DEPTH OF THE SOCK. REMOVED SEDIMENT SHALL BE DISPOSED OF IN A SUITABLE MANNER.
- 4. THE COMPOST SOCK SHALL BE INSPECTED AFTER EACH RAIN AND REPAIRS MADE AS NEEDED.
- 5. CONSTRUCTION OPERATIONS SHALL BE CARRIED OUT IN SUCH A MANNER THAT EROSION AND WATER POLLUTION SHALL BE MINIMIZED.
- 6. THE COMPOST SOCK SHALL BE REMOVED AND THE AREA STABILIZED WHEN THE TRIBUTARY DRAINAGE AREA HAS BEEN PROPERLY STABILIZED.



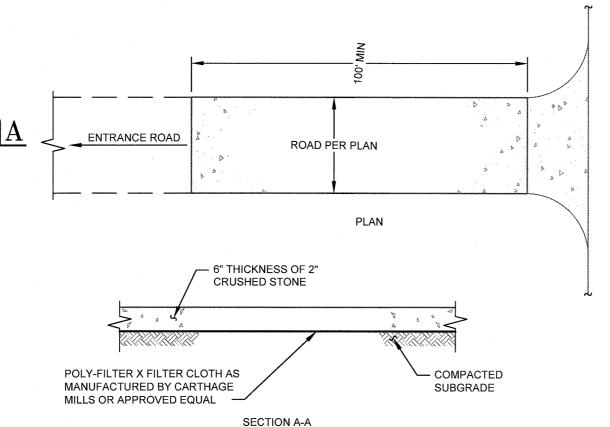

STABILIZE ENTIRE PILE

/ MIN. SLOPE

NOTES:

WITH VEGETATION OR COVER

- 1. STONE SIZE USE 2" STONE, OR RECLAIMED OR RECYCLED CONCRETE EQUIVALENT.
- 2. WIDTH 35 FOOT MINIMUM, BUT NOT LESS THAN THE FULL WIDTH AT POINTS WHERE INGRESS OR EGRESS OCCURS.
- SURFACE WATER ALL SURFACE WATER FLOWING OR DIVERTED TOWARD CONSTRUCTION ENTRANCES SHALL BE PIPED ACROSS THE ENTRANCE. IF PIPING IS IMPRACTICAL A MOUNTABLE BERM WITH 5:1 SLOPES WILL BE PERMITTED.
- 4. MAINTENANCE THE ENTRANCE SHALL BE MAINTAINED IN A CONDITION WHICH SHALL PREVENT TRACKING OR FLOWING OF SEDIMENT ONTO PUBLIC RIGHTS-OF-WAY. THIS MAY REQUIRED PERIODIC TOP DRESSING WITH ADDITIONAL STONE AS CONDITIONS DEMAND AND REPAIR AND/OR CLEANOUT OF ANY MEASURES USED TO TRAP SEDIMENT. ALL SEDIMENT SPILLED, DROPPED, WASHED, OR TRACKED ONTO PUBLIC RIGHTS-OF-WAY MUST BE REMOVED IMMEDIATELY.
- WASHING WHEELS SHALL BE CLEANED TO REMOVE SEDIMENT PRIOR TO ENTRANCE ONTO PUBLIC RIGHTS-OF-WAY. WHEN WASHING IS REQUIRED, IT SHALL BE DONE ON AN AREA STABILIZED WITH STONE AND WHICH DRAINS INTO AN APPROVED SEDIMENT TRAPPING DEVICE.
- 6. PERIODIC INSPECTIONS AND NEEDED MAINTENANCE SHALL BE PROVIDED AFTER

STABILIZED CONSTRUCTION ENTRANCE

SLOPE OR LESS

STRAWBALES OR SILTFENCE


3. UPON COMPLETION OF SOIL STOCKPILING, EACH PILE SHALL BE SURROUNDED A WITH

EITHER SILT FENCING OR STRAWBALES, THEN STABILIZED WITH VEGETATION OR COVERED.

1. AREA CHOSEN FOR STOCKPILING OPERATIONS SHALL BE DRY AND STABLE.

4. SEE SPECIFICATIONS (THIS MANUAL) FOR INSTALLATION OF SILTFENCE.

2. MAXIMUM SLOPE OF STOCKPILE SHALL BE 1:2.

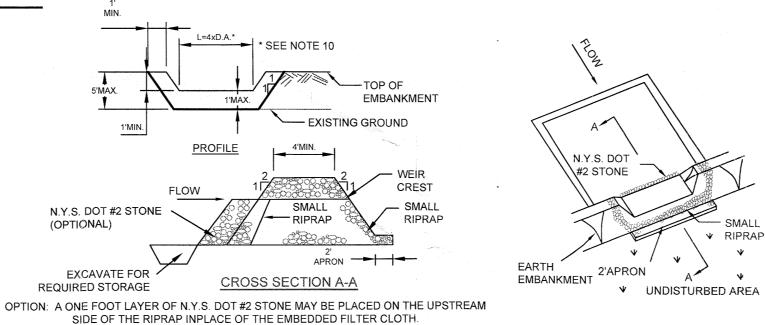

CONSTRUCTION SPECIFICATIONS

WALL BLOCK UNITS SET BACK

4'-0" MAX

1 1/4" PER 8" BLOCK (TYP)

2 FIBERGLASS PINS -

LEVELING PAD -

COLORS TO MATCH FOUNDATION STONE.

RECOMMENDATIONS.

PER BLOCK (TYP)

1. AREA UNDER EMBANKMENT SHALL BE CLEARED, GRUBBED AND STRIPPED OF ANY VEGETATION AND ROOT MAT. THE POOL AREA SHALL BE CLEARED.

2. THE FILL MATERIAL FOR THE EMBANKMENT SHALL BE FREE OF ROOTS AND OTHER WOODY VEGETATION AS WELL AS OVER-SIZED STONES, ROCKS, ORGANIC MATERIAL OR OTHER OBJECTIONABLE MATERIAL. THE EMBANKMENT SHALL BE COMPACTED BY TRAVERSING WITH EQUIPMENT WHILE IT IS BEING CONSTRUCTED.

3. ALL CUT AND FILL SLOPES SHALL BE 2:1 OR FLATTER.

4. THE STONE USED IN THE OUTLET SHALL BE SMALL RIPRAP 4"-8" ALONG WITH A 1' THICKNESS OF 2" AGGREGATE PLACED ON THE UP-GRADE SIDE ON THE SMALL RIPRAP OR EMBEDDED FILTER CLOTH IN THE

5. SEDIMENT SHALL BE REMOVED AND TRAP RESTORED TO ITS ORIGINAL DIMENSIONS WHEN THE SEDIMENT HAS ACCUMULATED TO 1/2 THE DESIGN DEPTH OF THE TRAP.

6. THE STRUCTURE SHALL BE INSPECTED AFTER EACH RAIN AND REPAIRS MADE AS NEEDED.

7. CONSTRUCTION OPERATIONS SHALL BE CARRIED OUT IN SUCH A MANNER THAT EROSION AND WATER POLLUTION IS MINIMIZED.

8. THE STRUCTURE SHALL BE REMOVED AND THE AREA STABILIZED WHEN THE DRAINAGE AREA HAS BEEN PROPERLY STABILIZED. MAXIMUM DRAINAGE AREA 5 ACRES.

9. LOCATION OF TRAP(S) TO BE DETERMINED IN THE FIELD BY EROSION & SEDIMENT CONTROL INSPECTOR. 10. THE LENGTH (FEET) OF THE OUTLET STRUCTURE SHALL BE EQUAL TO FOUR (4) TIMES THE DRAINAGE AREA

TEMPORARY STONE OUTLET SEDIMENT TRAP

FENCE POST @ 8'-0" OC -

SILT FENCE FABRIC

(3'-0" WIDE) MIRAFI

EXCAVATED /

1. SILT FENCE TO BE MAINTAINED IN

PLACE DURING CONSTRUCTION AND SOIL STABILIZATION PERIOD.

TRENCH ___/

NOTES:

BACKFILL

- 2. ALL TOPSOIL, ROOTS, STUMPS AND OTHER DELETERIOUS MATERIAL SHALL BE REMOVED FROM ALL CONSTRUCTION AREAS.
- 3. ALL FILL FOR POND CONSTRUCTION, BELOW BUILDINGS AND PAVEMENT TO BE COMPACTED TO 95% OF MAXIMUM DRY DENSITY AS DETERMINED BY MODIFIED PROCTOR COMPACTION TEST ASTM D1557.
- 4. CELLAR, ROOF AND FOOTING DRAINS SHALL CONNECT TO THE STORM DRAINAGE SYSTEM OR OTHER FREE-FLOWING OUTLET AT A MINIMUM SLOPE OF 0.5%. FOOTING DRAIN SHALL BE INSTALLED BENEATH
- 5. COMPLETION OF GRADING AND BASIN, BERMS AFTER OCTOBER 15 SHALL REQUIRE MULCHING AND ANCHORING IN ACCORDANCE WITH NOTES ENTITLED "SEDIMENTATION EROSION CONTROL".
- 6. ALL SLOPES IN EXCESS OF 3H:1V SHALL BE CONSTRUCTED WITH LOCALLY AVAILABLE GLACIAL TILL. THE EMBANKMENT FILL SHALL BE PLACED IN SIX-INCHTHICK LIFTS. EACH LIFT SHALL BE PLACED AND COMPACTED TO 95% OF MAXIMUM DRY DENSITY AS DETERMINED BY MODIFIED PROCTOR COMPACTION
- 7. CONSTRUCT POND EMBANKMENT WITH LOCALLY AVAILABLE GLACIAL TILL WITH 3H:1V SIDE SLOPES OR AS NOTED ON PLAN. THE EMBANKMENT FILL SHALL BE PLACED IN A SIX-INCH THICK CONTINUOUS LAYER OVER THE ENTIRE LENGTH.EACH LIFT SHALL BE PLACED AT OPTIMUM MOISTURE CONTENT AND COMPACTED TO 95% OF MAXIMUM DRY DENSITY AS DETERMINED BY MODIFIED PROCTOR COMPACTION TEST ASTM D1557.
- 8. STABILIZATION OF POND BERMS, AND ALL SLOPES IN EXCESS OF 3H:1V IN ACCORDANCE WITH "EROSION AND SEDIMENTATION CONTROL NOTES".
- 9. ALL POND OUTLETS SHALL HAVE SEEPAGE CONTROL COLLARS PLACED AT 1/3 AND 2/3 THE WIDTH OF THE EMBANKMENT.
- 10. SOIL RESTORATION SHALL BE APPLIED TO ALL DISTURBED AREAS THAT WILL REMAIN AS PERVIOUS SURFACES. SOIL RESTORATION SHALL CONSIST OF THE FOLLOWING:
- 10.A. APPLY 3 INCHES OF COMPOST OVER SUBSOIL
- 10.B. TILL COMPOST INTO SUBSOIL TO A DEPTH OF AT LEAST 12 INCHES USING A CAT-MOUNTED RIPPER, TRACTOR MOUNTED DISC, OR TILLER, MIXING, AND CIRCULATING AIR AND COMPOST INTO
- 10.C. ROCK-PICK UNTIL UPLIFTED STONE/ROCK MATERIALS OF FOUR INCHES AND LARGER SIZE ARE CLEANED OFF THE SITE:
- 10.D. APPLY TOPSOIL TO A DEPTH OF 6 INCHES.

-FACE OF EXCAVATION

SLOPED OR BRACED

IN ACCORDANCE WITH

OSHA REQUIREMENTS

10.E. VEGETATE IN ACCORDANCE WITH LANDSCAPE PLAN.

EROSION AND SEDIMENTATION CONTROL NOTES

- 1. SITE DISTURBANCE SHALL BE LIMITED TO THE MINIMUM NECESSARY GRADING AND VEGETATION REMOVAL REQUIRED
- 2. TEMPORARY EROSION CONTROL MEASURES, INCLUDING SILT FENCES AND/OR STRAW BALE DIKES, SEDIMENT BASIN, TEMPORARY DIVERSION SWALE DRAINAGE STRUCTURES, AND RIP-RAP PROTECTION SHALL BE INSTALLED PRIOR TO GROUND DISTURBANCE FOR GRADING AND CONSTRUCTION.
- 3. ALL DISTURBED AREAS SHALL BE SEEDED AND MULCHED AS SOON AS PRACTICAL FOLLOWING DISTURBANCE TO
- STABILIZE BARE SOIL AND PROMOTE THE PROMPT RE-ESTABLISHMENT OF VEGETATION: 3.1. AN ADEQUATE SEEDBED SHALL BE PREPARED BY SCARIFYING COMPACTED SOIL AND REMOVING SURFACE DEBRIS
- 3.2. LIME SHALL BE APPLIED SUFFICIENTLY TO ATTAIN A SOIL ACIDITY PH OF 6.0 TO 7.0.
- 3.3. FERTILIZER (5-10-10 MIXTURE OR EQUIVALENT) SHALL BE APPLIED PER SOIL TEST RESULTS OR AT A RATE OF 600
- 3.4. DISTURBED AREAS WHICH WILL REMAIN TEMPORARILY FALLOW FOR PERIODS GREATER THAN 30 DAYS SHALL BE SEEDED AT THE FOLLOWING RATE TO PRODUCE TEMPORARY GROUND COVER: 30 LBS. RYEGRASS (ANNUAL OR PERENNIAL) PER ACRE. DURING THE WINTER, USE 100 LBS. CERTIFIED "AROOSTOOK" WINTER RYE (CEREAL RYE)
- 3.5. PERMANENT SEEDING SHALL BE APPLIED ON 4" MIN TOPSOIL AT THE FOLLOWING RATE: 8 LBS EMPIRE BIRDSFOOT TREFOIL OR COMMON WHITE CLOVER PER ACRE PLUS
 - 20 LBS TALL FESCUE PER ACRE PLUS
- 2 LBS REDTOP OR 5 LBS RYEGRASS (PERENNIAL) PER ACRE 3.6. ALL SEEDING SHALL BE PERFORMED USING THE BROADCAST METHOD OR HYDROSEEDING, UNLESS OTHERWISE
- 3.7. ALL DISTURBED AREAS SHALL BE STABILIZED SUBSEQUENT TO SEEDING BY APPLYING 2 TONS OF STRAW MULCH PER ACRE. STRAW MULCH SHALL BE ANCHORED BY APPLYING 750 LBS OF WOOD FIBER MULCH PER ACRE WITH A HYDROSEEDER, OR TUCKING THE MULCH WITH SMOOTH DISCS OR OTHER MULCH ANCHORING TOOLS TO A DEPTH OF 3". MULCH ANCHORING TOOLS SHALL BE PULLED ACROSS SLOPES ALONG TOPOGRAPHIC CONTOURS.
- 4. ALL EROSION AND SEDIMENTATION CONTROL MEASURES AND DRAINAGE STRUCTURES SHALL BE INSPECTED FOLLOWING EVERY RAIN EVENT, AND MAINTENANCE AND REPAIRS SHALL BE PERFORMED PROMPTLY TO MAINTAIN PROPER FUNCTION. TRAPPED SEDIMENT SHALL BE REMOVED AND DEPOSITED IN A PROTECTED AREA IN A PROPER MANNER WHICH WILL NOT RESULT IN EROSION.
- 5. TEMPORARY CONTROL MEASURES SHALL REMAIN IN PLACE UNTIL DISTURBED AREAS ARE PERMANENTLY STABILIZED AND GROUND COVER IS COMPLETELY REESTABLISHED. FOLLOWING STABILIZATION, TEMPORARY MEASURES SHALL BE REMOVED TO AVOID INTERFERENCE WITH DRAINAGE.
- 6. ALL STORM INLETS TO BE PROTECTED FROM SEDIMENTATION DURING CONSTRUCTION.
- 7. SYNTHETIC OR ORGANIC SOIL STABILIZERS MAY BE USED UNDER SUITABLE CONDITIONS AND IN SUFFICIENT
- 8. MULCH NETTING SUCH AS PAPER, JUTE, EXCELSIOR, COTTON OR PLASTIC MAY BE USED. STAPLE IN PLACE. OVER HAY OR STRAW MULCH. USE A DEGRADABLE NETTING IN AREAS TO BE MOWED.
- 9. STABILIZATION OF STEEP SLOPES SHALL BE ACHIEVED BY APPLYING LIME AND FERTILIZER AS SPECIFIED ABOVE AND SEEDING WITH THE FOLLOWING MIXTURE:
 - CROWN VETCH SPREADING FESCUE
- 10. OPTIMUM SEEDING PERIODS ARE 3/15-6/1 AND 8/1-10/15.
- 11. ALL UPSTREAM SITE WORK AND STABILIZATION SHALL OCCUR BEFORE CONNECTING UNDERGROUND DETENTION/INFILTRATION FACILITY TO PREVENT ANY ERODED SEDIMENTS FROM ENTERING UNDERGROUND FACILITY.
- 12. IN ACCORDANCE WITH THE NYSDEC SPDES GP 0-20-001, THERE SHALL BE NO MORE THAN 5 ACRES DISTURBED AT ANYONE TIME.

SOIL RESTORATION NOTES

Type of Soil Disturbance	Soil Restoration Requirement		Comments / Examples
No Soil Disturbance	permitted		Preservation of Natural Features
Minimal Soil Disturbance			Clearing and Grubbing
Areas where	HSG A & B	HSG C & D	Protect Areas from any
topsoil is stripped only – NO change in grade.	Apply 6" of topsoil	Aerate* and apply 6" of topsoil	ongoing construction activities.
	HSG A & B	HSG C & D	
Areas of cut or fill	Aerate* and apply 6" of topsoil	Apply full Soil Restoration	
Heavy traffic areas on site (especially in a zone 5'-25' around buildings, but not within the 5' perimeter around the foundation walls)	Restoration not required, but maybe applied to enhance the reduction specified for appropriate practices		
Areas where Runoff Reduction and/or Infiltration Practices are applied.			Keep construction equipment from crossing these areas. To protect newly installed practice from any ongoing construction activities construct a single phase operation fence area.
Areas where existing impervious area will be converted to pervious area			

* Aeration includes the use of machines such as tractor-drawn implements with coulters making a narrow slit in the soil, a roller with many spikes making indentations in the soil, or prongs which function like a mini-

** Per "Deep Ripping and De-compaction Guidelines", NYSDEC 2008

Dig Safely. New York

	DATE	DESCRIPTION	DRAWING STATUS	<u>ISS</u> 04
***	***************************************	INITIAL SUBMISSION REVISED PER COMMENT LETTERS	 THIS SHEET IS PART OF	S
-	09/21/21		THE PLAN SET ISSUED FOR	NU
		REVISED PER PLANNING BOARD COMMENTS	CONCEPT APPROVAL	N/A
-	04/07/22	REVISED FOR WETLAND MITIGATION AREA	PLANNING BOARD APPROVAL	14
_		100 A	 OCDOH REALTY SUBDIVISION APPROVAL	N/A
_			OCDOH WATERMAIN EXTENSION APPROVAL	N/A
-			□NYSDEC APPROVAL	N/A
_	•		NYSDOT APPROVAL	N/A
_			OTHER	N/A
-	***************************************		☐FOR BID	N/A
_			FOR CONSTRUCTION	N/A
			THIS PLAN SET HAS BEEN ISSUED SPECIFICAL APPROVAL OR ACTION NOTED ABOVE AND SHAFOR ANY OTHER PURPOSE. THIS SHEET SHALL BE CONSIDERED INVALID	LY FOR TALL NOT

FINISHED GRADE -

-DRAINAGE FILL DESIGN

AS PER MANUFACTURE

UNDISTURBED

1. PROPOSED KEYSTONE KS HALF CENTURY RETAINING WALL SHALL BE DESIGNED AS PER THE MANUFACTURER.

2. FENCING SHALL BE INSTALLED FOR AS SHOWN ON THE PLANS, IN ACCORDANCE WITH MANUFACTURER'S

4. FOR WALLS OVER HEIGHTS OF 4-0" SEE SPECIFIC ENGINEERED WALL DETAILS AS PREPARED BY OTHERS.

TYPICAL MSE RETAINING WALL


SUBGRADE~

REINFORCED EARTH FILL

COMPACTED TO 95% OF MODIFIED

PROCTOR MAXIMUM DENSITY~

DRAWING STATUS		JE D/ /07/		·
THIS SHEET IS PART OF THE PLAN SET ISSUED FOR		SHEET NUMBER		
CONCEPT APPROVAL	N/A	OF	N/A	İ
☑ PLANNING BOARD APPROVAL	14	OF	14	
OCDOH REALTY SUBDIVISION APPROVAL	N/A	OF	N/A	
OCDOH WATERMAIN EXTENSION APPROVAL	N/A	OF	N/A	
□NYSDEC APPROVAL	N/A	OF	N/A	
☐NYSDOT APPROVAL	N/A	OF	N/A	
OTHER	N/A	OF	N/A	
☐FOR BID	N/A	OF	N/A	
☐ FOR CONSTRUCTION	N/A	OF	N/A	
THIS PLAN SET HAS BEEN ISSUED SPECIFICALLY FOR THE APPROVAL OR ACTION NOTED ABOVE AND SHALL NOT BE USED FOR ANY OTHER PURPOSE. THIS SHEET SHALL BE CONSIDERED INVALID UNLESS ACCOMPANIED BY ALL SHEETS OF THE DENOTED PLAN SET(S).				

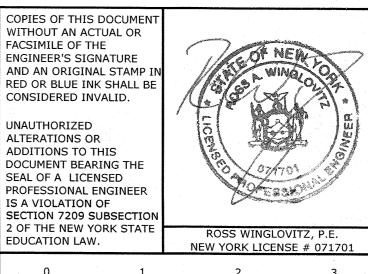

ORIGINAL SCALE IN INCHES


Ph: (845) 457-7727 Achieving Successful Results with Innovative Designs WWW.EP-PC.COM DETAILS MONARCH WOODS SENIOR COMMUNITY MONARCH DRIVE TOWN OF NEWBURGH ORANGE COUNTY, NEW YORK AS NOTED C-306

4 - 04/07/22 103-7-18 & 47-1-46

MONTGOMERY OFFICE

MONTGOMERY, NY 12549

71 CLINTON STREET

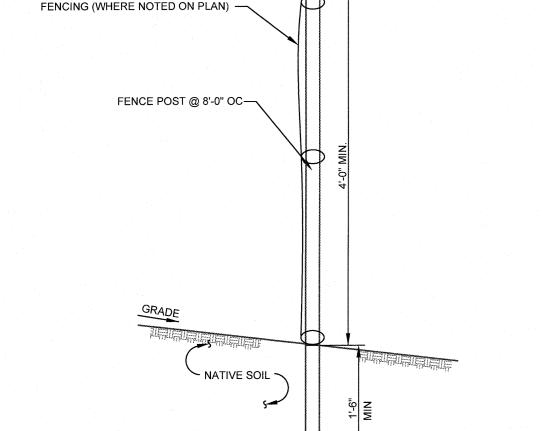

ORANGE CONSTRUCTION

1. ORANGE CONSTRUCTION FENCE LOCATIONS SHALL BE STAKED BY A SURVEYOR AND INSTALLATION SHALL BE CONFIRMED BY THE ENGINEER PRIOR TO ANY LAND DISTURBANCE WITHIN 125 FEET OF AN EXISTING WETLAND AND IN AREAS WHERE TREES AND STONE WALLS ARE TO BE PRESERVED.

2. ALL ORANGE CONSTRUCTION FENCING SHALL BE MAINTAINED THROUGHOUT CONSTRUCTION TO PROTECT SENSITIVE AREAS.

3. THE ORANGE CONSTRUCTION FENCING WILL BE REMOVED UPON FINAL STABILIZATION OF ALL AREAS WITHIN 125 FEET OF FENCING.

ORANGE CONSTRUCTION FENCE